
linkedpro
by epcom®

4257-2099 A

linkedpro
by epcom®

Uninterruptible Power Systems

10~20kVA

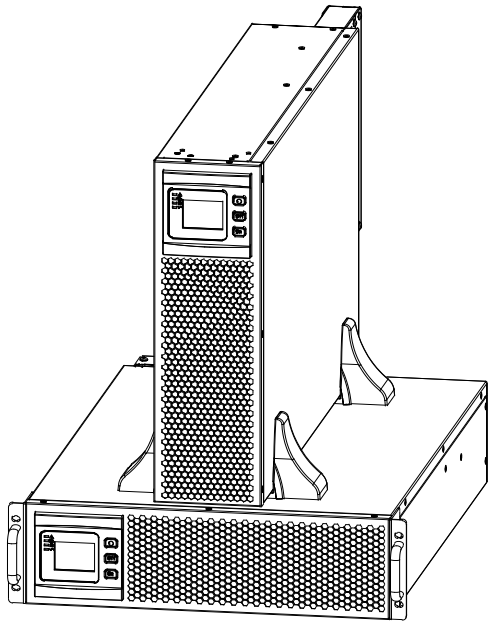

Operation Manual

All rights reserved.
The information in this document is subject to change without notice.

Publish statement

Thank you for purchasing this series UPS.
This series UPS is an intelligent, three phase in Three phase out, high frequency online UPS designed by our R&D team who is with years of designing experiences on UPS. With excellent electrical performance, perfect intelligent monitoring and network functions, smart appearance, complying with EMC and safety standards, The UPS meets the world’s advanced level.
Read this manual carefully before installation
This manual provides technical support to the operator of the equipment.
Contact the nearest hazardous waste disposal station when the products or components are discarded

Contents

1．Safety 2
1.1 Safety notes 2
1.2 Symbols used in this guide 2
2．Main Features 3
2.1 Summarization 3
2.2 Functions and Features 3
3．Installation 4
3.1 Sub Rack UPS 4
3.2 Tower UPS 5
3.3 Cabinet Outlook 7
3.3 LCD control panel 8
3.4 Installation notes 8
3.5 External Protective Devices 9
3.6 Power Cables 9
3.7 Power cable connect 11
3.8 Battery connection 14
3.9 UPS parallel Installation 15
3.10 Connection of the PDU to UPS dry contact port 16
3.10.1 Output breaker auxiliary signal cable connection 16
3.10.2 Maintenance breaker auxiliary signal cable connection 16
3.11 Computer access 17
4．Operation 19
4.1 Operation Modes 19
4.2 Turn on/off UPS 22
4.3 The LCD Display 27
4.4 Display Messages/Troubleshooting 37
4.5 Options 41
Appendix 1 Specifications 42
Appendix 2 Problems and Solution 44
Appendix 3 USB communication port definition 45
Appendix 4 RS232 communication port definition 46
Appendix 5 RS485 communication port definition 47
Appendix 6 Dry contact port definition 48
Appendix 7 Backfeed protection port definition 49
Appendix 8 REPO instruction 49
Appendix 9 Sub rack UPS dimension 50
Appendix 10 Tower UPS dimension 51

1．Safety

Important safety instructions - Save these instructions

There exists dangerous voltage and high temperature inside the UPS. During the installation, operation and maintenance, please abide the local safety instructions and relative laws, otherwise it will result in personnel injury or equipment damage. Safety instructions in this manual act as a supplementary for the local safety instructions. Our company will not assume the liability that caused by disobeying safety instructions.

1.1 Safety notes

1. Even no connection with utility power, 120/127VAC voltage may still exist at UPS terminal!
2. For the sake of human being safety, please well earth the UPS before starting it.
3．Don't open or damage battery, for the liquid spilled from the battery is strongly poisonous and do harmful to body!
4．Please avoid short circuit between anode and cathode of battery, otherwise, it will cause spark or fire!
5．Don't disassemble the UPS cover, or there may be an electric shock!
6．Check if there exists high voltage before touching the battery
7．Working environment and storage way will affect the lifetime and reliability of the UPS. Avoid the UPS from working under following environment for long time
   - Area where the humidity and temperature is out of the specified range(temperature 0 to 40℃, relative humidity 5%-95%)
   - Direct sunlight or location nearby heat
   - Vibration Area with possibility to get the UPS crashed.
   - Area with erosive gas, flammable gas, excessive dust, etc
8．Keep ventilations in good conditions otherwise the components inside the UPS will be over-heated which may affect the life of the UPS.

1.2 Symbols used in this guide



WARNING!

Risk of electric shock



CAUTION!

Read this information to avoid equipment damage

2 . Main Features

2.1 Summarization

This series UPS is a kind of three-in-three-out high frequency online UPS.

The UPS can solve most of the power supply problems, such as blackout, over-voltage, under-voltage, voltage sudden drop, oscillating of decreasing extent, high voltage pulse, voltage fluctuation, surge, inrush current, harmonic distortion (THD), noise interference, frequency fluctuation, etc..

This UPS can be applied to different applications from computer device, automatic equipment, communication system to industry equipment.

2.2 Functions and Features

◆Integrated solution for data center

UPS can be integrated with battery cabinet, PDU external maintenance bypass, offering excellent choice for data center.

◆3Phase In/3Phase Out UPS

It is 3Phase In/3Phase Out high-density UPS system, of which input current is kept in balance. No unbalance problem might occur.

◆Digital Control

This series UPS is controlled by Digital Signal Processor (DSP); enhance, it increases reliability, performance, self-protection, and self-diagnostics and so on.

◆Battery Configurable

From 16 blocks to 26 blocks, the battery voltage of this series UPS can be configured at 16 blocks, 18 blocks, 20 blocks, 22 blocks, 24 blocks, 26 blocks according to your convenience.

◆Charging Current is configurable

Via setting tool, the user may set the capacity of the batteries as well as reasonable charging current as well as maximum charging current. Constant voltage mode, constant current mode or floating mode can be switched automatically and smoothly.

◆Intelligent Charging Method

The series UPS adopts advanced three-stage charging method—

1st stage: high current constant current charging

to guarantee to charge back to 90%;

2nd-stage: Constant Voltage

In order to vitalize battery and make sure batteries are fully charged

3rd stage: floating mode.

With this 3-stage charging method, it extends the life of the batteries and guarantees fast charging.

◆LCD Display

With LCD plus LED displays, the user may easily get UPS status and its operational parameters, such as input/output voltage, frequency & load%, battery % and ambient temperature, etc...

◆Intelligent Monitoring Function

Via optional SNMP Card, you may remotely control and monitor the UPS.


◆EPO Function

The series UPS may be completely shut off when the EPO is pressed. REPO function (Remote EPO) is also available in this series UPS.

3．Installation

3.1 Sub Rack UPS


3.1.1 Appearance of UPS

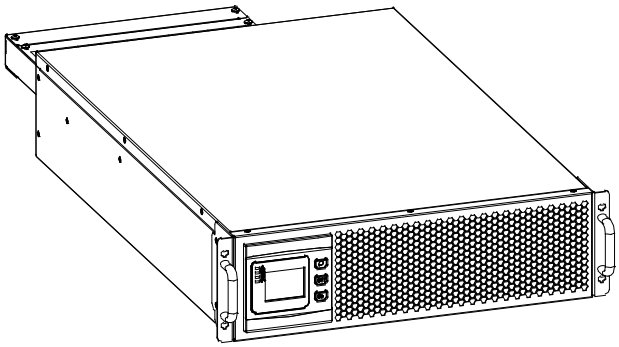


10/15/20kVA

3.1.2 Installation

Adjust the length of the rails according to the following figure according to the distance of the cabinet and fix the rails.

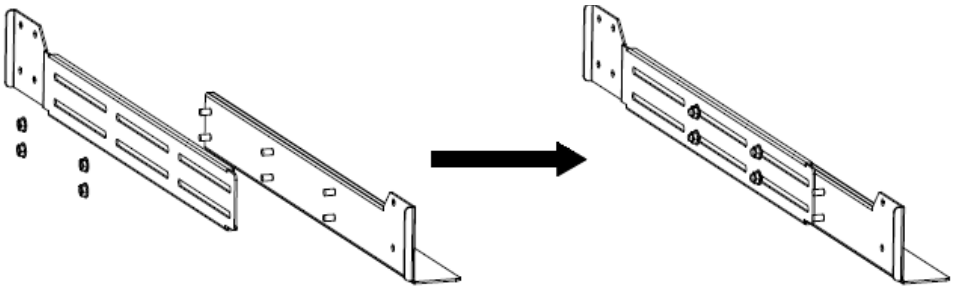


Fix the rails to the cabinet.

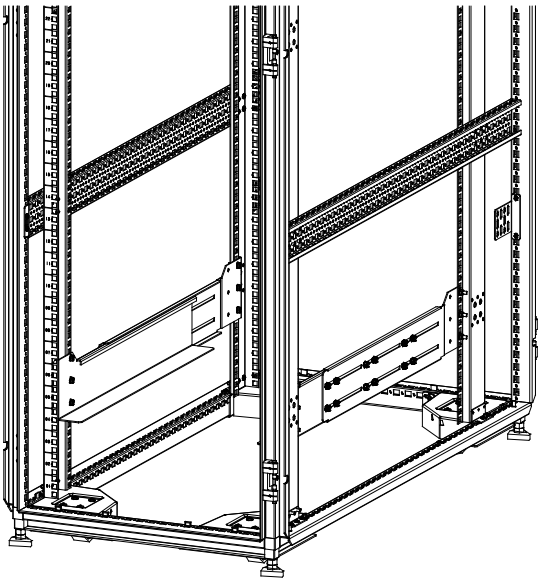

10/15/20kVA


After installing the rails, install the floating screw according to the front panel of the UPS, then insert the UPS into the cabinet on the rails and fix the screws.

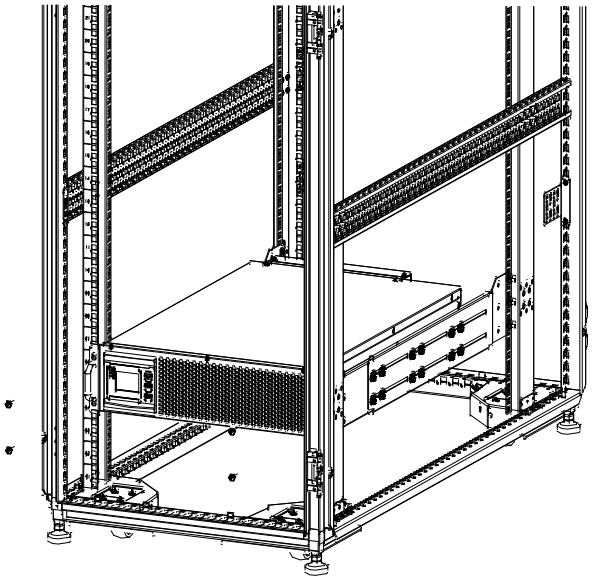

10/15/20kVA

3.2 Tower UPS


3.2.1 Appearance of UPS

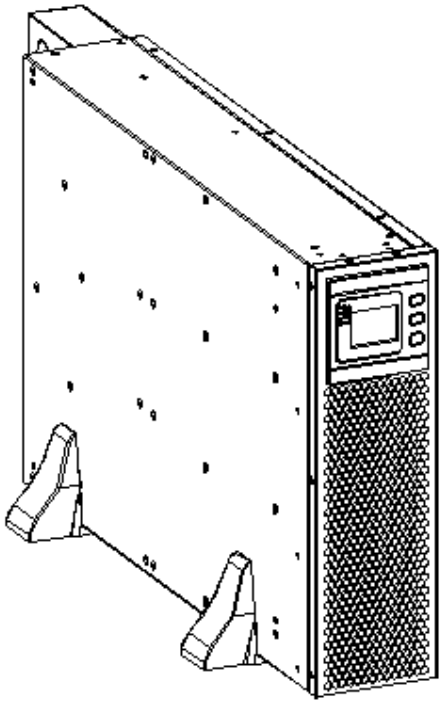

10/15/20kVA


3.2.2 Installation

Remove the fix handles of the UPS

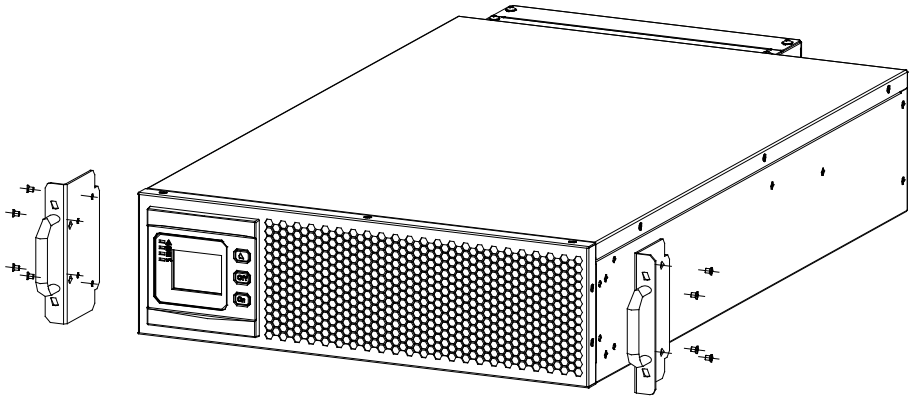

10/15/20kVA


Assemb the bracket, according to the size of the UPS, and then the UPS can be directly placed on the bracket.

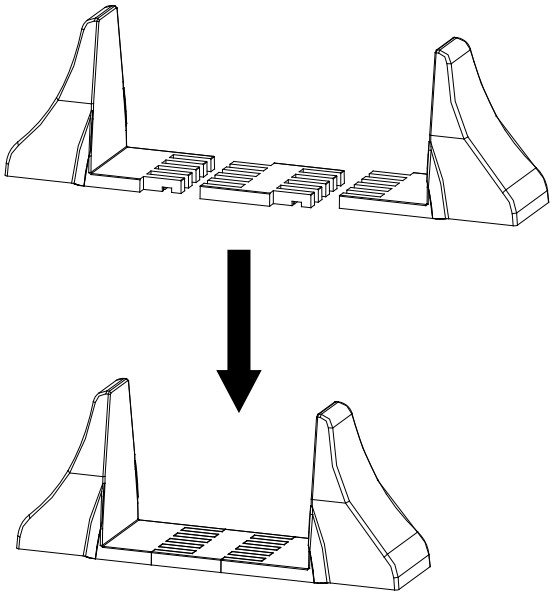


10/15/20kVA

3.3 Cabinet Outlook

10/15/20kVA:

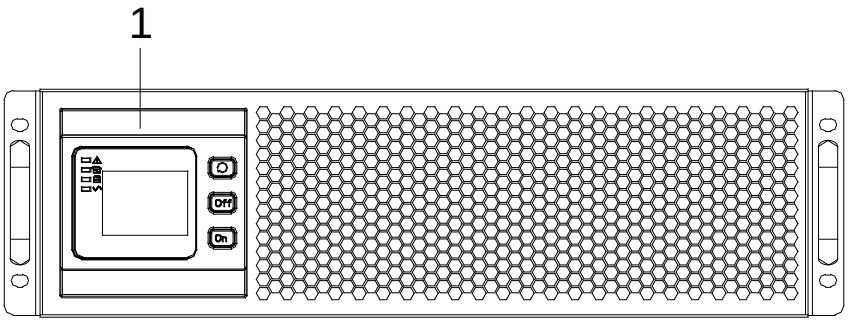


Front View

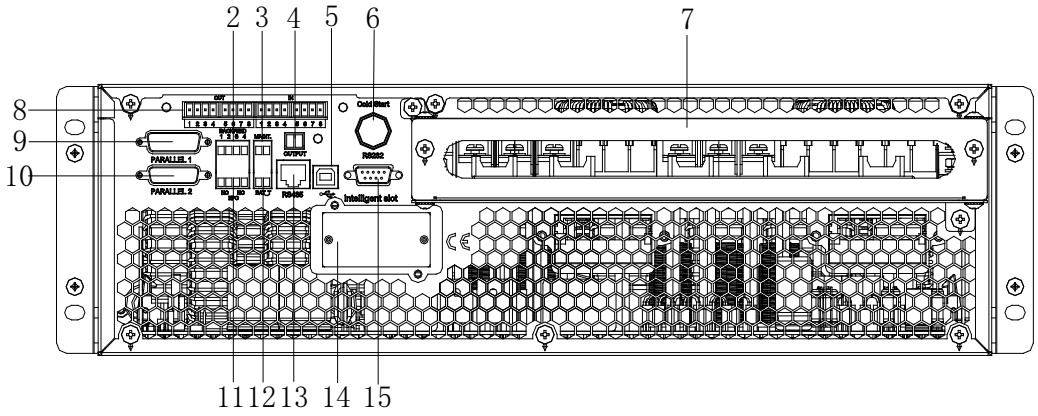

Rear View

(1) LCD panel	(2) Backfeed protection port
(3) MAINTAIN-AUXSWS port	(4) Output breaker aux contactor
(5) USB port	(6) Cold-start button
(7) Terminal block for Input, output & battery	(8) Dry contact port
(9) Parallel port 1	(10) Parallel port 2
(11) EPO port	(12) Temperature sensor port (for NTC)
(13) RS485 port	(14) Intelligent Slot (SNMP card)
(15) RS232 port	

3.3 LCD control panel

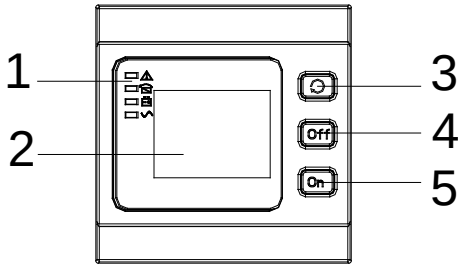

LCD control panel introduction

(1) LED (from top to bottom: “alarm”, “bypass”, “battery”, “inverter”)　(2) LCD display
(3) scroll button　(4) Off button　(5) On button

3.4 Installation notes

Note: Consider for the convenience of operation and maintenance, the space in front and back of the cabinet should be left at least 100cm and 80cm respectively when installing the cabinet.

◆Please place the UPS in a clean, stable environment, avoid the vibration, dust, humidity, flammable gas and liquid, corrosive. To avoid from high room temperature, a system of room extractor fans is recommended to be installed. Optional air filters are available if the UPS operates in a dusty environment.

◆The environment temperature around UPS should keep in a range of 0℃～40℃. If the environment temperature exceeds 40℃, the rated load capacity should be reduced by 12% per 5℃. The max temperature can't be higher than 50℃.

◆If the UPS is dismantled under low temperature, it might be in a condensing condition. The UPS can't be installed unless the internal and external of the equipment is fully dry. Otherwise, there will be in danger of electric shock.

◆Batteries should be mounted in an environment where the temperature is within the required specs. Temperature is a major factor in determining battery life and capacity. In a normal installation, the battery temperature is maintained between 15°C and 25°C. Keep batteries away from heat sources or main air ventilation area, etc.



WARNING!

Typical battery performance data are quoted for an operating temperature between 20°C and 25°C. Operating it above this range will reduce the battery life while operation below this range will reduce the battery capacity.

◆Should the equipment not be installed immediately it must be stored in a room so as to protect it against excessive humidity and or heat sources.



CAUTION!

An unused battery must be recharged every 6months Temporarily connecting the UPS to a suitable AC supply mains and activating it for the time required for recharging the batteries.

◆The highest altitude that UPS may work normally with full load is 1500 meters. The load capacity should be reduced when this UPS is installed in place whose altitude is higher than 1500 meters, shown as the following table:

(Load coefficient equals max load in high altitude place divided by nominal power of the UPS)

Altitude (m)	1500	2000	2500	3000	3500	4000	4500	5000
Load coefficient	100%	95%	90%	85%	80%	75%	70%	65%

◆The UPS cooling is depending on fan, so it should be kept in good air ventilation area. There are many ventilation holes on the front and rear, so they should not be blocked by any exotic obstacles.

3.5 External Protective Devices

For safety reasons, it is necessary to install, external circuit breaker at the input A.C. supply and the battery. This chapter provides guidelines for qualified installers that must have the knowledge of local wiring practices for the equipment to be installed.

◆**External Battery**

The UPS and its associated batteries are protected against the effect of over-current through a DC compatible thermo-magnetic circuit-breaker (or a set of fuses) located close to the battery.

◆**UPS Output**

Any external distribution board used for load distribution shall be fitted with protective devices that may avoid the risk of UPS overloaded.

◆**Over-current**

Protection device shall be installed at the distribution panel of the incoming main supply. It may identify the power cables current capacity as well as the overload capacity of the system.

3.6 Power Cables

◆The cable design shall comply with the voltages and currents provided in this section, Kindly follow local wiring practices and take into consideration the environmental conditions (temperature and physical support media) .



WARNING!

Upon starting. Please ensure that you are aware of the location and operation of the external isolators which are connected to the UPS input/bypass supply of the mains distribution panel. Check to see if these supplies are electrically isolated. And post and necessary warning signs to prevent any inadvertent operation.

3.6.1 Recommended cross-sectional areas for power cables

UPS cabinet	Cable Dimension			
	AC Input	AC Output	DC Input	Grounding
10kVA	8AWG	8AWG	6AWG	8AWG
15kVA	6AWG	6AWG	4AWG	6AWG
20kVA	4AWG	4AWG	2AWG	4AWG

- When selecting, connecting, and routing power cables, follow local safety regulations and rules.
- If external conditions such as cable layout or ambient temperatures change, perform verification in accordance with the IEC-60364-5-52 or local regulations.
- If the rated voltage is 208 V, multiply the currents by 0.95. If the rated voltage is 220 V, multiply the currents by 0.92.
- If primary loads are non-linear loads, increase the cross-sectional areas of neutral wires1.5–1.7 times.
- The nominal battery discharge current refers to the current of forty 12 V batteries at 480V in standard configuration.
- The maximum battery discharge current refers to the current when forty 12 V batteries in standard configuration, that is, two hundred and forty 2 V battery cells (1.67 V/cell), stop discharging.
- The battery cable specifications are selected based on 20 batteries by default and compatible with application scenarios with 16–26 batteries.
- When the mains input and bypass input share a power source, configure both types of input power cables as mains input power cables. The cables listed in Table are used only when the following requirements are met:

  − Routing mode: Routing the cables over the cable ladder or bracket in a single layer (IEC60364-5-52 middle E).

  − The ambient temperature is 30°C.

  − The AC voltage loss is less than 3%, and the DC voltage loss is less than 1%.

  − 90°C copper flexible cable.

  − The length of the AC power cables of a UPS is no longer than 30 m and DC power cables no longer than 50 m.

3.6.2 Power cable connector requirements

Model	Connector	Connection Mode	Bolt Type	Bolt Hole Diameter	Torque
10/15/20kVA	Mains input connector	Crimped OT terminals	L-M4/N-M6	4.5/7mm	2/7N•m
	Bypass input	Crimped OT	L-M4/N-M6	4.5/7mm	2/7N•m

	connector	terminals			
	Battery input connector	Crimped OT terminals	M6	7mm	7N•m
	Output connector	Crimped OT terminals	L-M4/N-M6	4.5/7mm	2/7N•m
	Grounding connector	Crimped OT terminals	M6	7mm	7N•m

3.6.3 Recommended input front-end and output back-end circuit breakers

Model	Mains input circuit breaker	Bypass input circuit breaker	Maintenance circuit breaker	Output circuit breaker	Battery circuit breaker
10kVA	40A 3P	40A 3P	40A 4P	50A 3P	63A 3P
15kVA	63A 3P	63A 3P	63A 4P	63A 3P	100A 3P
20kVA	80A 3P	80A 3P	80A 4P	80A 3P	125A 3P



CAUTION!

Protective earth cable: Connect each cabinet to the main ground system. For Grounding connection, follow the shortest route possible.



WARNING!

Failure to follow adequate earthing procedures may result in electromagnetic interference or in hazards involving electric shock and fire

3.7 Power cable connect


Once the equipment has been finally positioned and secured, connect the power cables as described in the following procedure.

Verify the UPS is totally isolated from its external power source and also all power isolators of the PDU are open. Check to see if they are electrically isolated, and post any necessary warning signs to prevent their inadvertent operation.

Open the UPS rear panel; Remove the cover of terminals for wiring easily.

3.7.1 Common input connection


10/15/20kVA

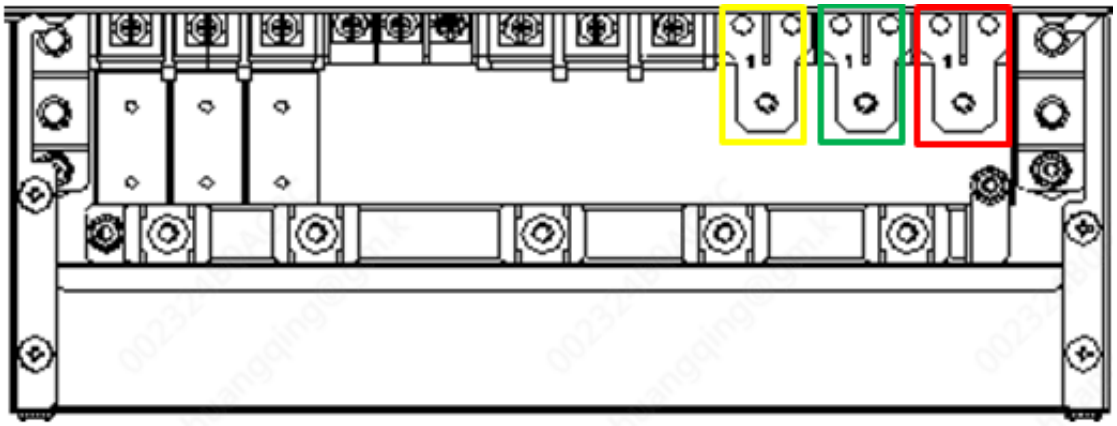

INPUT Primary input Line	**OUTPUT**
	Vout-L1: Output Phase L1
Vin-L1: Primary input Phase L1	**Vout-L2:** Output Phase L2
Vin-L2: Primary input Phase L2	**Vout-L3:** Output Phase L3
Vin-L3: Primary input Phase L3	**Vout-N:** Output Neutral
Vin-N: Input Neutral for primary and secondary input	**PE:** Grounding
	BAT+: Positive terminal of the batteries string
	BATN: Neutral terminal of the batteries string
	BAT-: Negative terminal of the batteries string

3.7.2 Dual input connection

10/15/20kVA

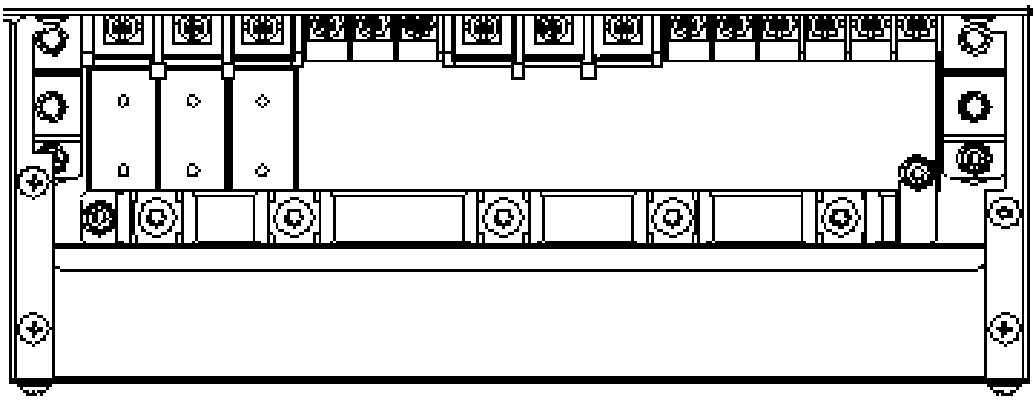


Mains Primary input Line	**Output**
Bypass Secondary/Bypass input line (optional)	**Vout-L1:** Output Phase L1

Vin-L1: Primary input Phase L1	**Vout-L2:** Output Phase L2
Vin-L2: Primary input Phase L2	**Vout-L3:** Output Phase L3
Vin-L3: Primary input Phase L3	**Vout-N:** Output Neutral
Vin-N: Input Neutral for primary and secondary input	**PE:** Grounding
BPS-L1: Secondary input Phase L1	**BAT+:** Positive terminal of the batteries string
BPS-L2: Secondary input Phase L2	**BATN:** Neutral terminal of the batteries string
BPS-L3: Secondary input Phase L3	**BAT-:** Negative terminal of the batteries string

Warning !

In the case of “Dual input” operation, make sure the copper wire between each input lines have been removed. The AC input and the AC bypass supplies must be referenced to the same neutral point.

Choose appropriate power cable. (Refer to the table above) and pay attention to the diameter of the connection terminal of the cable that should be greater than or equal to that of the connection poles;

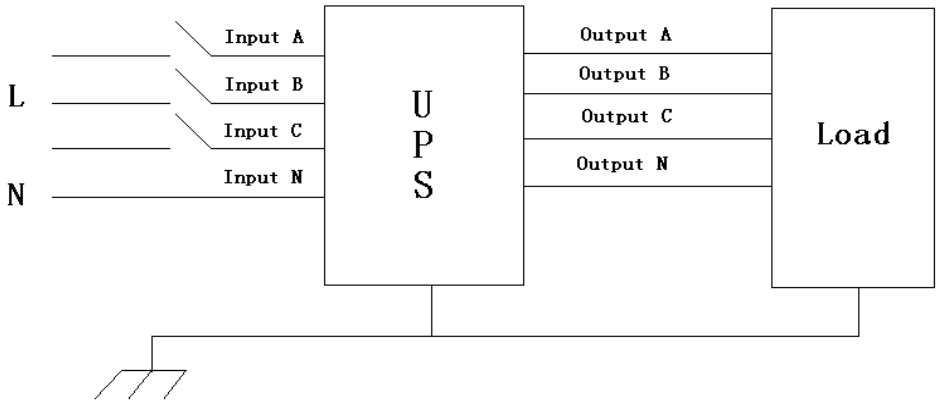

WARNING!

If the load equipment is not ready to accept power on the arrival of the commissioning engineer then ensure that the system output cables are safely isolated at their ends

Connect the safety earth and any necessary bonding earth cables to the copper earth screw located on the floor of the equipment below the power connections. All cabinets in the UPS must be grounded properly.


CAUTION!

The earthing and neutral bonding arrangement must be in accordance with local and national codes of practice.

3.8 Battery connection

The UPS adopts positive and negative double battery framework, total 16(optional 18/20/22/24/26) in series. A neutral cable is retrieved from the joint between the cathode of the 8th (9th/10th/11 th/12th/13th) and the anode of the 9th (10th/11th/12 th/13th/14 th) of the batteries. Then the neutral cable, the battery Positive and the battery negative are connected with the UPS respectively. The battery sets between the Battery anode and the neutral are called positive batteries and that between neutral and cathode are called negative ones. The user can choose the capacity and the numbers of the batteries according to their desire.

External battery connections for long-run units.

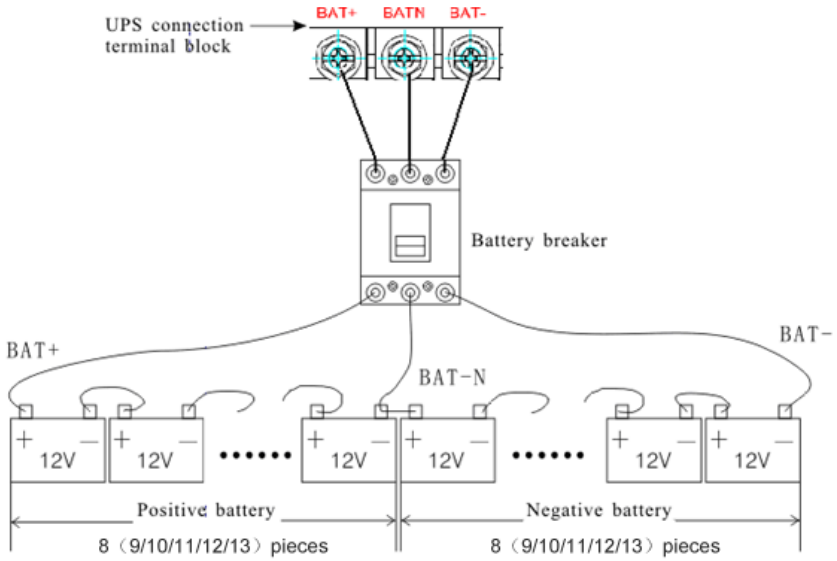

Note：

The BAT+ of the UPS connect poles is connected to the anode of the positive battery, the BAT-N is connected to the cathode of the positive battery and the anode of the negative battery, the BAT- is connected to the cathode of the negative battery.

factory setting of the long-run unit is battery quantity---20pcs, battery capacity---12V65AH (charger current 6.5A). When connecting 16/18/20/22/24/26batteries, please re-set desired battery quantity and its capacity after UPS starts at AC mode. Charger current could be adjusted automatically according to battery capacity selected. All related settings can be done through LCD panel or monitoring software

CAUTION!

Ensure correct polarity battery string series connection. I.e. inter-tier and inter block connections are from (+) to (-) terminals. Don’t mix batteries with different capacity or different brands, or even mix up new and old batteries, either.

WARNING!

Ensure correct polarity of string end connections to the Battery Circuit Breaker and from the Battery Circuit Breaker to the UPS terminals i.e. (+) to (+) / (-) to (-) but disconnect one or more battery cell links in each tier. Do not reconnect these links and do not


close the battery circuit breaker unless authorized by the commissioning engineer.

3.9 UPS parallel Installation

The following sections introduce the installation procedures specified to the parallel system.

3.9.1 Cabinet installation

Connect all the UPS needed to be put into parallel system as below picture.

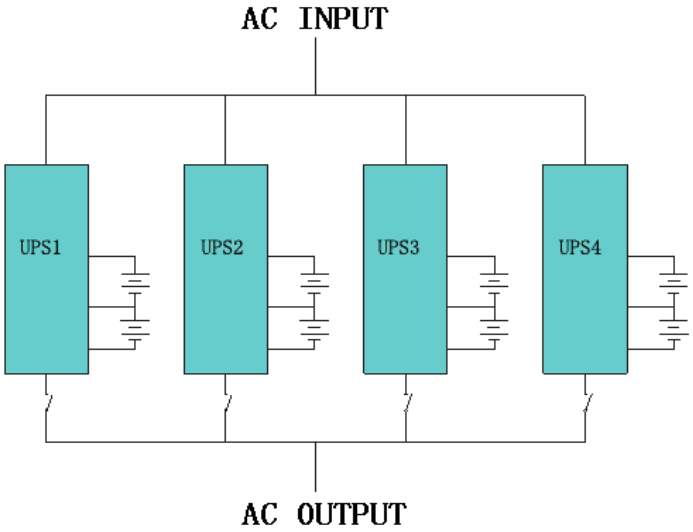

Make sure each UPS input breaker is in “off” position and there is no any output from each UPS connected. Battery groups can be connected separately or in parallel, which means the system itself provides both separate battery and common battery.



WARNING!

Make sure the N, A (L1), B (L2), C (L3) lines are correct, and grounding is well connected.

3.9.2 Requirement for the parallel system

A group of paralleled UPS behaves as one large UPS system but with the advantage of presenting higher reliability. In order to assure that all UPS are equally utilized and comply with relevant wiring rules, please follow the requirements below:

1) All UPS must be of the same rating and be connected to the same bypass source.


2) The outputs of all the UPS must be connected to a common output bus.

3) The length and specification of power cables including the bypass input cables and the UPS output cables should be the same. This facilitates load sharing when operating in bypass mode.

3.10 Connection of the PDU to UPS dry contact port


3.10.1 Output breaker auxiliary signal cable connection

Connect the auxiliary contact interface of the output breaker of the PDU and the dry contact interface of the ups output breaker with cables. The dry contact of the UPS is normally open logic and can be enabled when the interface is short. In parallel mode, when the output breaker is disconnected ups automatically turn off the inverter.

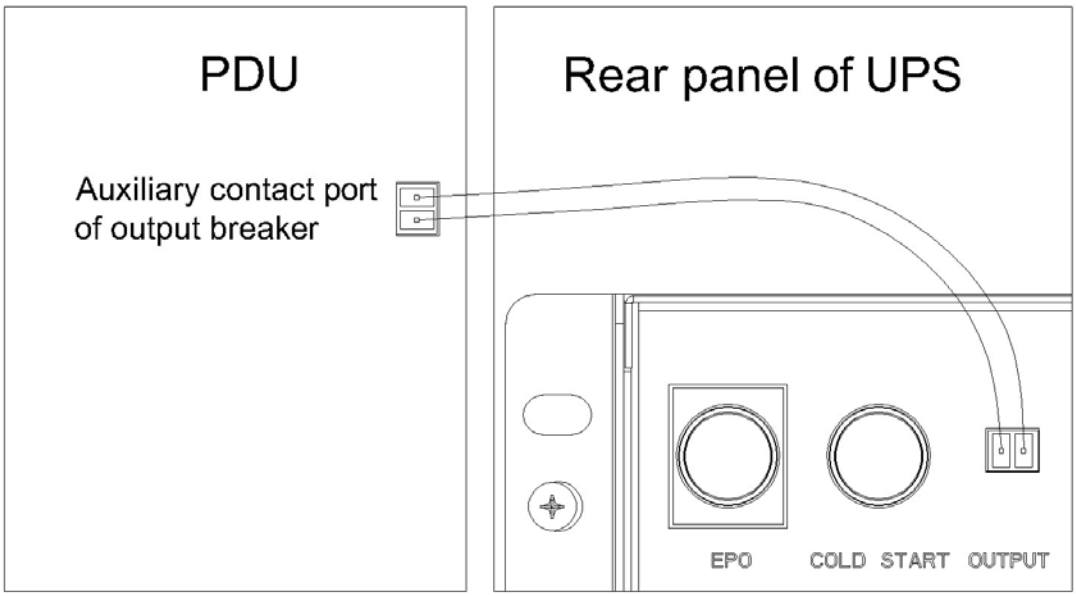


3.10.2 Maintenance breaker auxiliary signal cable connection

◆ Connect the auxiliary contact interface of the maintenance breaker of the PDU and the dry contact interface of the ups output dry port with cables. The dry contact of the UPS is normally open logic and can be enabled when the interface is short.

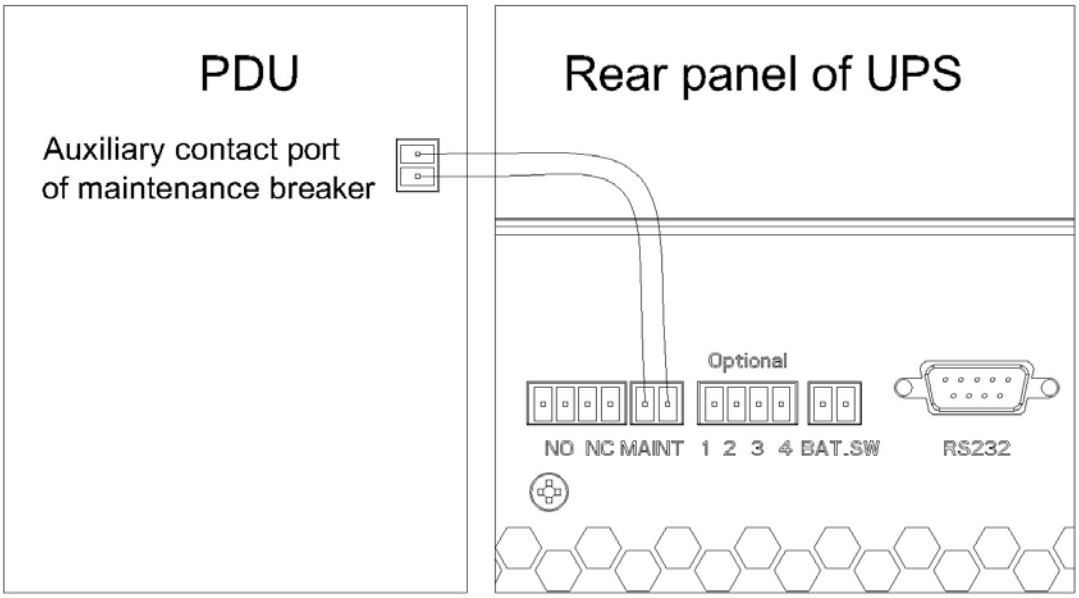


◆10-20K When the maintenance breaker cover of the PDU is opened, the ups connected to the breaker will receive the dry contact signal and enter the maintenance state automatically.

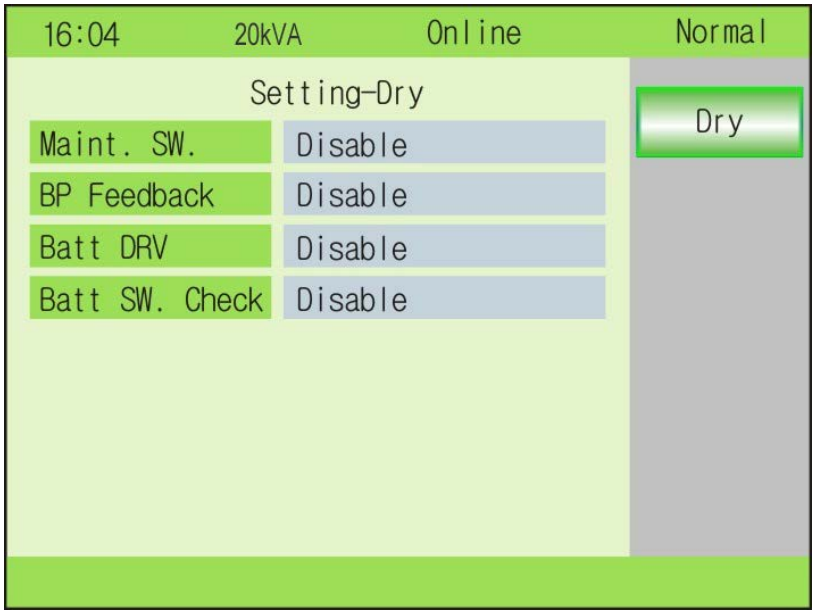


3.11 Computer access

◆One end of a USB cable connect to the computer, the other end connect to the USB port on the UPS.


◆Open the software Muser5000, click “system” button.

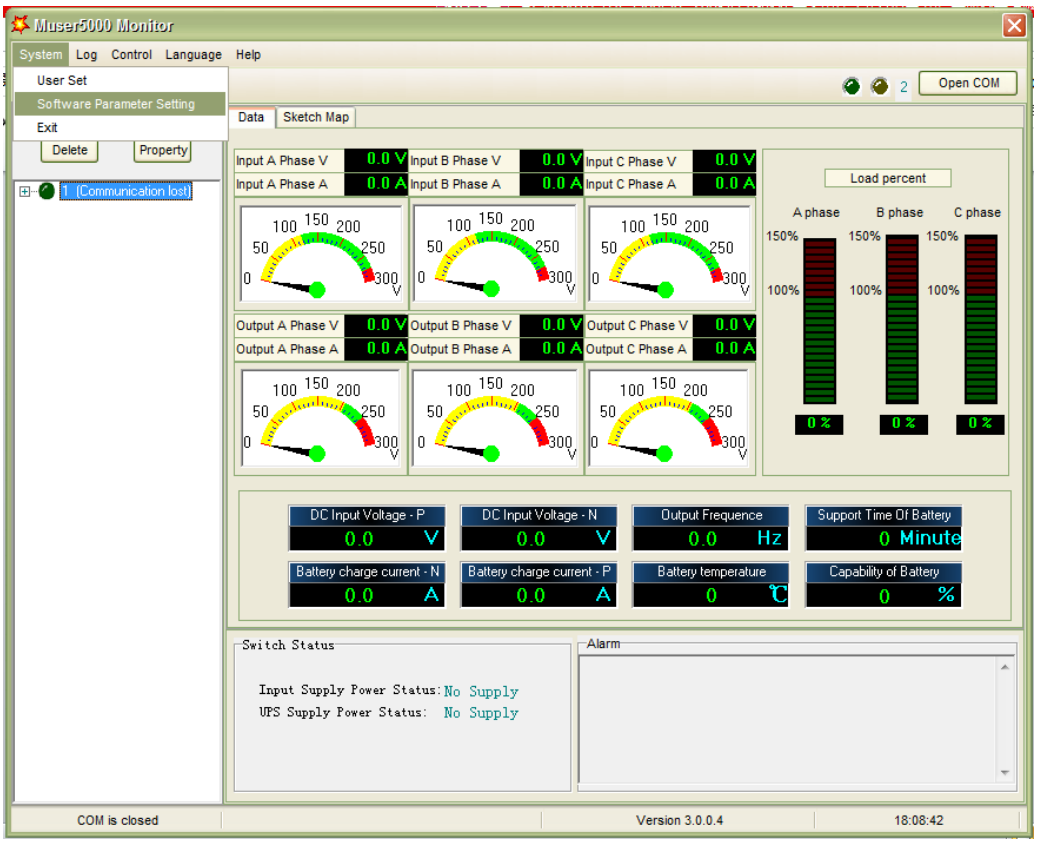


◆A window of “Software Parameter Setting” comes out as below, COM choose according to the UPS , baud rate choose 9600, protocol choose “modbus”, then save this setting.

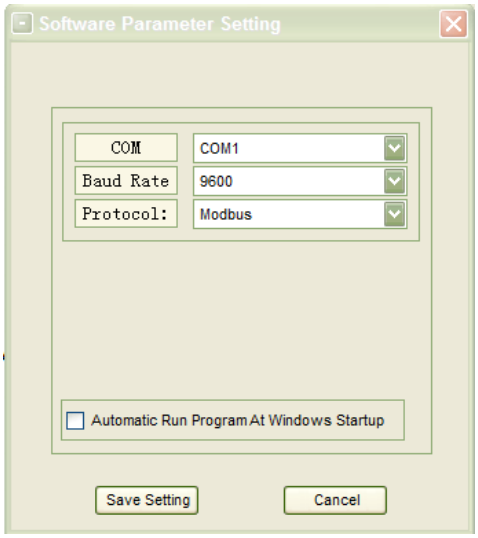

◆On the main page of Muser5000, click the button of “Append”, then goes to a window of “Append equipment”. Password is YDC3350.

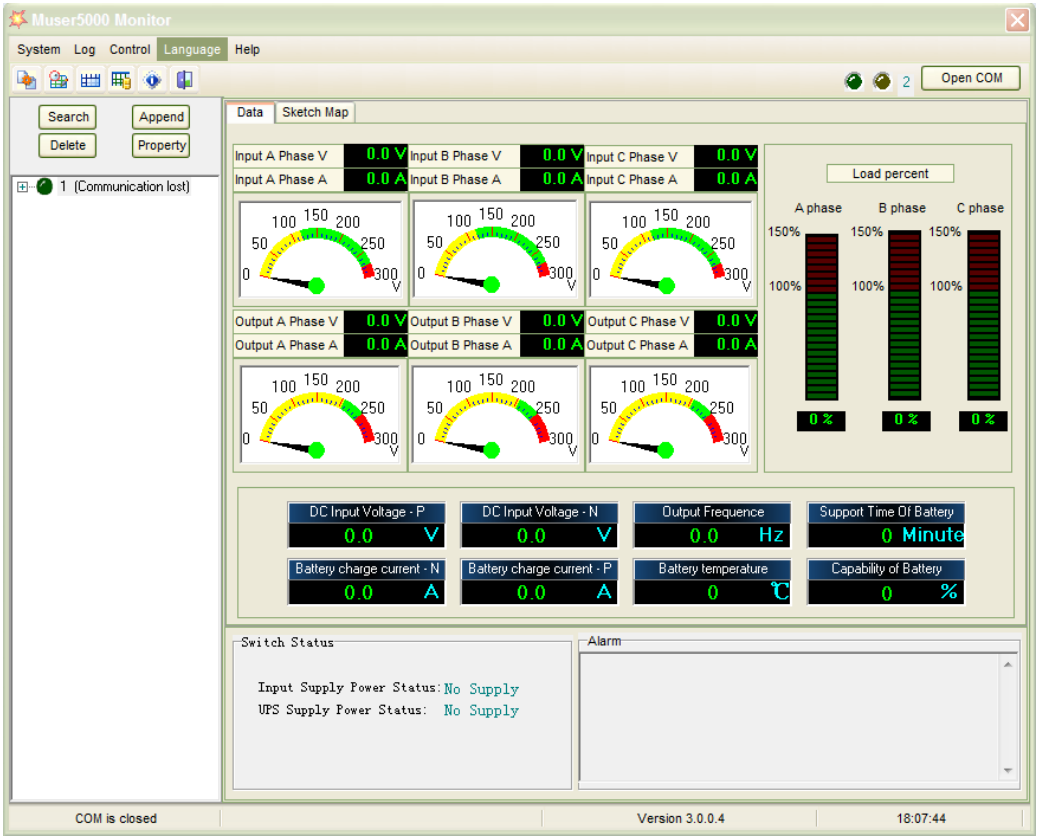

◆Put the UPS name into “Equipment Name”, and UPS’ ID address into “Equipment address”.

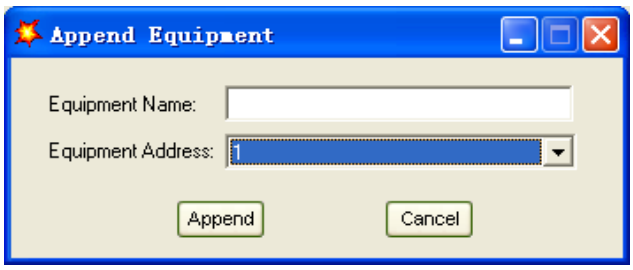

◆Click the button “Append”, then the connection between UPS & computer is accomplished.

CAUTION!
When the UPS worked on inverter. If you want to use PC to set the output voltage and frequency. Must shut down the inverter first


4 . Operation

4.1 Operation Modes


The UPS is a double-conversion on-line UPS that may operate in the following alternative modes：

◆Normal mode

The rectifier/charger derives power from the AC Mains and supplies DC power to the inverter while floating and boosting charge the battery simultaneously. Then, the inverter converts the DC power to AC and supplies to the load.

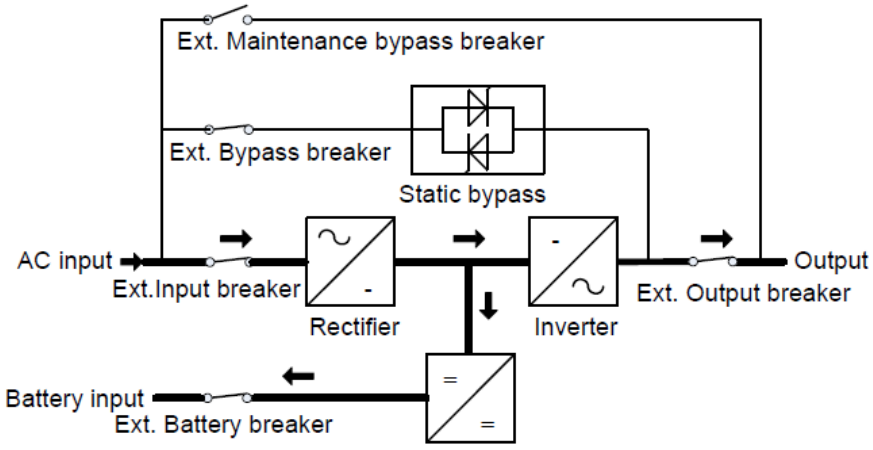


Single input

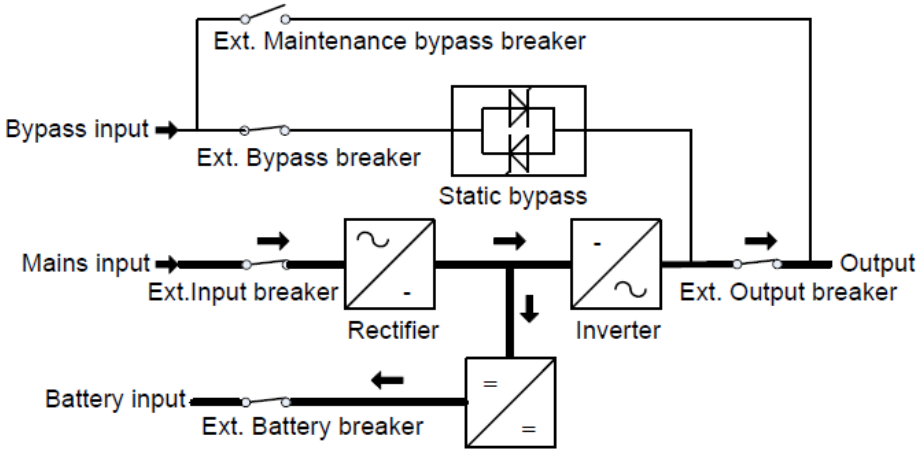


Dual input

◆Battery mode (Stored Energy Mode)

If the AC mains input power fails, the inverter, which obtains power from the battery, supplies the critical AC load. There is no power interruption to the critical load. The UPS will automatically return to Normal Mode when AC recovers.

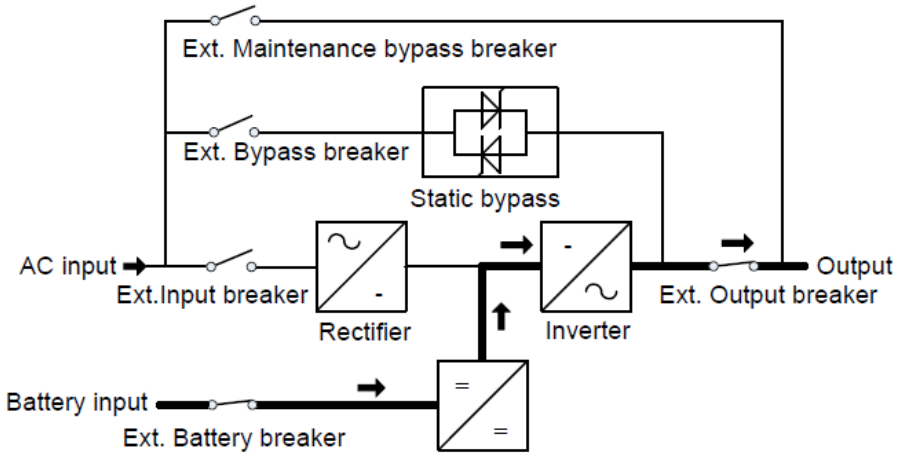


Single input

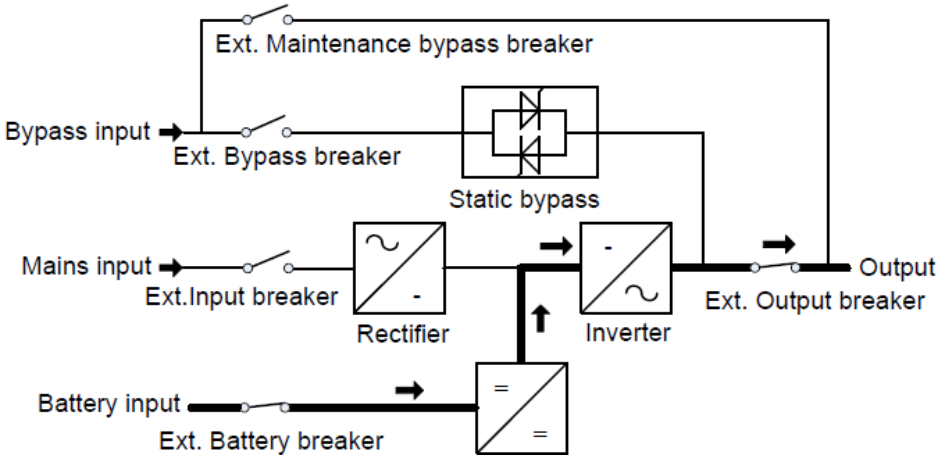


Dual input

◆Bypass mode

If the inverter is out of order, or if overload occurs, the static transfer switch will be activated to transfer the load from the inverter supply to bypass supply without interruption to the critical load. In the event that the inverter output is not synchronized with the bypass AC source, the static switch will perform a transfer of the load from the inverter to the bypass with power interruption to the critical AC load. This is to avoid paralleling of unsynchronized AC sources. This interruption is programmable but typically set to be less than an electrical cycle e.g. less than 15ms (50Hz) or less than 13.33ms (60Hz).

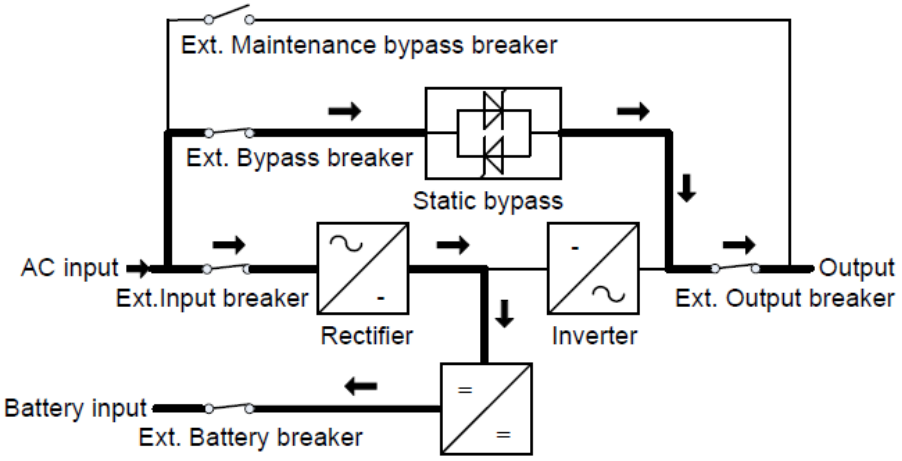


Single input

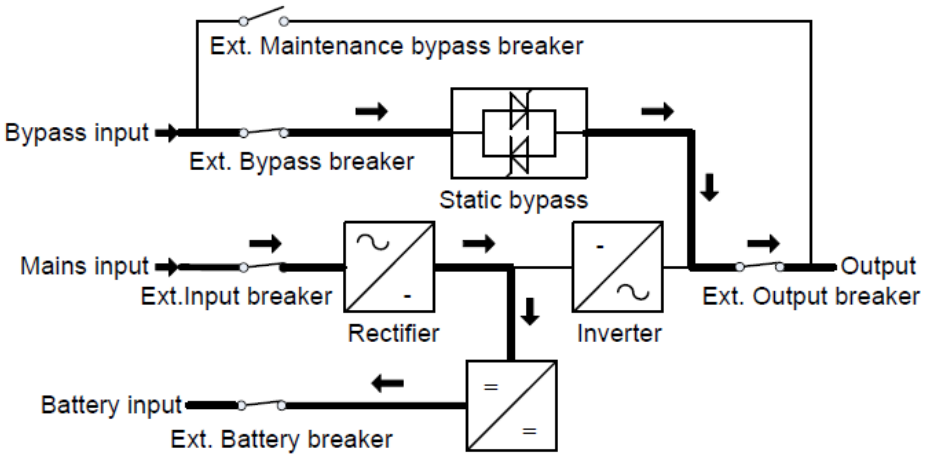


Dual input

◆ECO Mode

When the UPS is at AC Mode and the requirement to the load is not critical, the UPS can be set at ECO mode in order to increase the efficiency of the power supplied. At ECO mode, the UPS works at Line-interactive mode, so the UPS will transfer to bypass supply. When the AC is out of set window, the UPS will transfer from bypass to Inverter and supplies power from the battery, and then the LCD shows all related information on the screen.

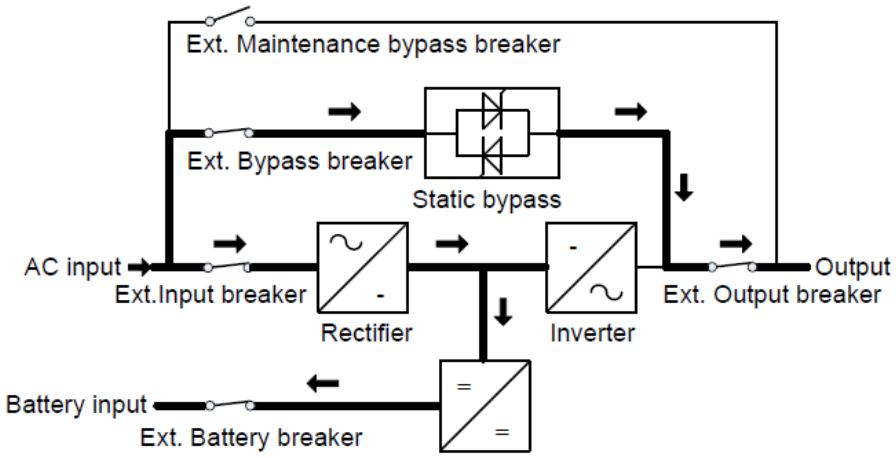


Single input

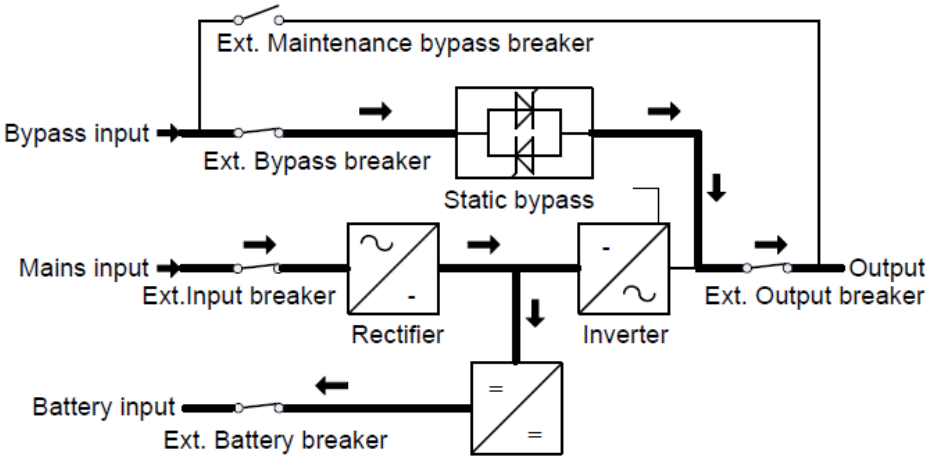


Dual input

◆**Maintenance mode (Manual Bypass)**

A manual bypass switch is available to ensure continuity of supply to the critical load when the UPS is out of order or in repair and this manual bypass switch bears for equivalent rated load.

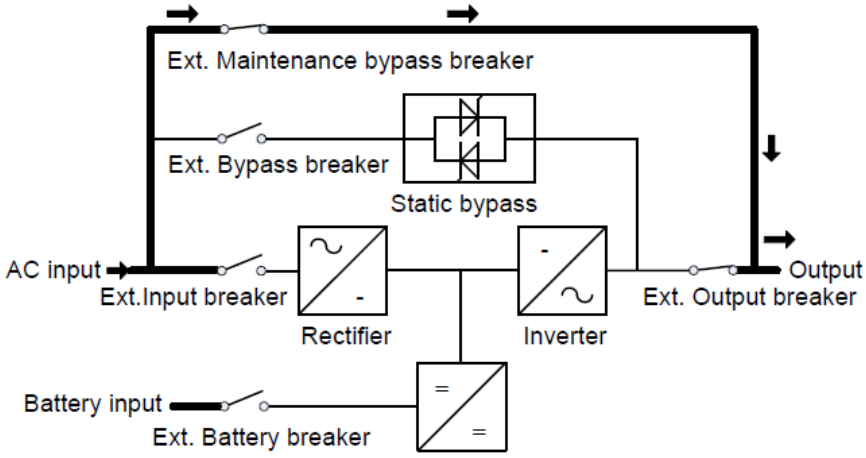

Single input

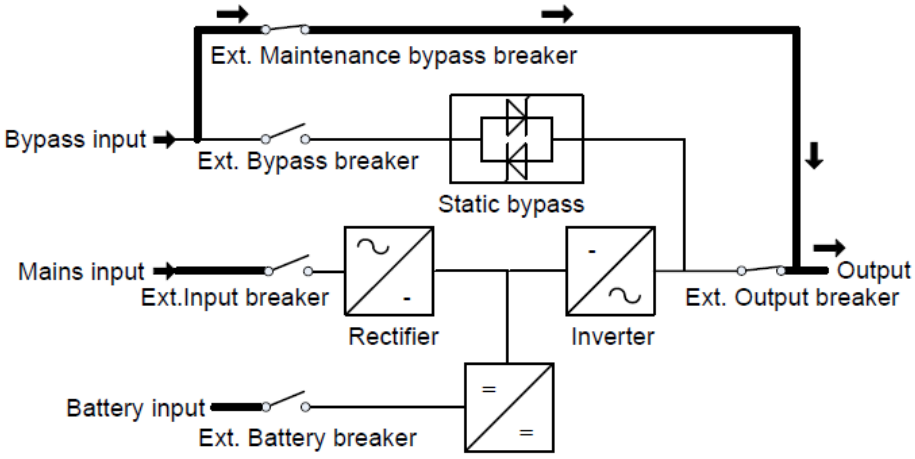

Dual input

4.2 Turn on/off UPS

4.2.1 Restart procedure

CAUTION!

MAKE SURE GROUNDING IS PROPERLY DONE!

◆ Set the Battery Breaker to the “ON” position according to the user’s manual.

CAUTION ！

Check to see if the load is safely connected with the output of the UPS. If the load is not ready to receive power from the UPS, make sure that it is safely isolated from the UPS output terminals

◆Turn ON OUTPUT breaker of the PDU.

◆ Turn ON BYPASS breaker and MAINS breaker of the PDU.

If the Rectifier input is within voltage range, the rectifier will start up in 30 seconds then the inverter will start up after then.

If the rectifier fails at startup, the bypass LED will light up. When the inverter starts up, the UPS will transfer from bypass mode to inverter mode, then the bypass LED extinguishes and the inverter LED lights up.

No matter whether the UPS can work normally or not, all the status will be shown on the LCD display.

4.2.2 Test procedure



CAUTION!

The UPS is operating normally. It may take 60 seconds to boost up the system and perform self-test completely.

- Switch off the MAINS to simulate utility failure, the rectifier will turn off and the battery should feed the inverter without interruption. At this time, the LEDs of battery should be turned on.
- Switch on the MAINS to simulate utility recovery, the rectifier will restart automatically after 20 seconds and the inverter will supply to the load. It is suggested to use Dummy loads for testing. The UPS can be loaded up to its maximum capacity during load test。

4.2.3 MAINTENANCE BYPASS

To supply the load via Mains, you may simply active the internal mechanical bypass switch.



CAUTION!

The load is not protected by the UPS when the internal mechanical bypass system is active and the power is not conditioned.

Switch to mechanical bypass



CAUTION!

If the UPS is running normally and can be controlled through the display, carry out steps 1 to 6; otherwise, jump to Step 5.

- Open the cover of maintenance switch, the UPS turns to bypass mode automatically.
- Turn on MAINTANCE breaker of the PDU;
- Switch OFF BATTERY breaker of the PDU;
- Switch OFF MAINS breaker of the PDU;
- Switch OFF BYPASS breaker of the PDU;
- Switch OFF OUTPUT breaker of the PDU;

At this time the bypass source will supply to the load through the MAINTENANCE breaker.

Switch to normal operation (from mechanical bypass)



CAUTION!

Never attempt to switch the UPS back to normal operation until you have

verified that there are no internal UPS faults.

- Turn ON OUTPUT breaker of the PDU.
- Turn ON BYPASS breaker of the PDU.
- Turn ON MAINS breaker of the PDU.

The UPS powers from the static bypass instead of the maintenance bypass, then the bypass LED will light up.

- Switch OFF the maintenance bypass breaker, then the output is supplied by the static bypass of the UPS.
- Put on the maintenance switch cover.

The rectifier will operate normally after 30 seconds. If the inverter works normally, the system will be transferred from bypass mode to normal mode.


4.2.4 Cold start procedure

CAUTION!

Follow these procedures when the input AC Utility Failure, but battery is normal

- Turn on the BATTERY breaker.

  The battery will feed the Auxiliary power board.
- Turn on the OUTPUT breaker.
- Trigger the cold start(Cold start) button as the position 11 of the below drawing.



When battery normal, rectifier starts operation, 30s later, inverter starts and operates and battery LED on.

CAUTION!

Please press the close start button after 30 seconds until closing the battery switch.

4.2.5 Shut down procedure

CAUTION!

This procedure should be followed to completely shut down the UPS and the LOAD. After all power switches, isolators and circuit breakers are opened, there will be no output.

- Switch OFF the BATTERY breaker ;

- Open the UPS door to easily access to the main power switch ;
- Switch OFF the MAINS breaker.
- Switch OFF the BYPASS breaker.
- Open the OUTPUT breaker. The UPS shuts down ;
- To completely isolate the UPS from AC Mains, all input switches of Utility shall be completely off, which includes the ones for rectifier and bypass.
- The primary input distribution panel, which is often located far away from the UPS area, so a label should be posted to advise service personnel that the UPS circuit is under maintenance.


WARNING!

Wait for about 5 minutes for the internal D.C. bus bar capacitors to be completely discharged.


4.2.6 Parallel setting

- Connect the UPS with computer. Power on the UPS.


◆Open Muser5000 software, after connecting with the UPS successfully, click "System"->"User Set"

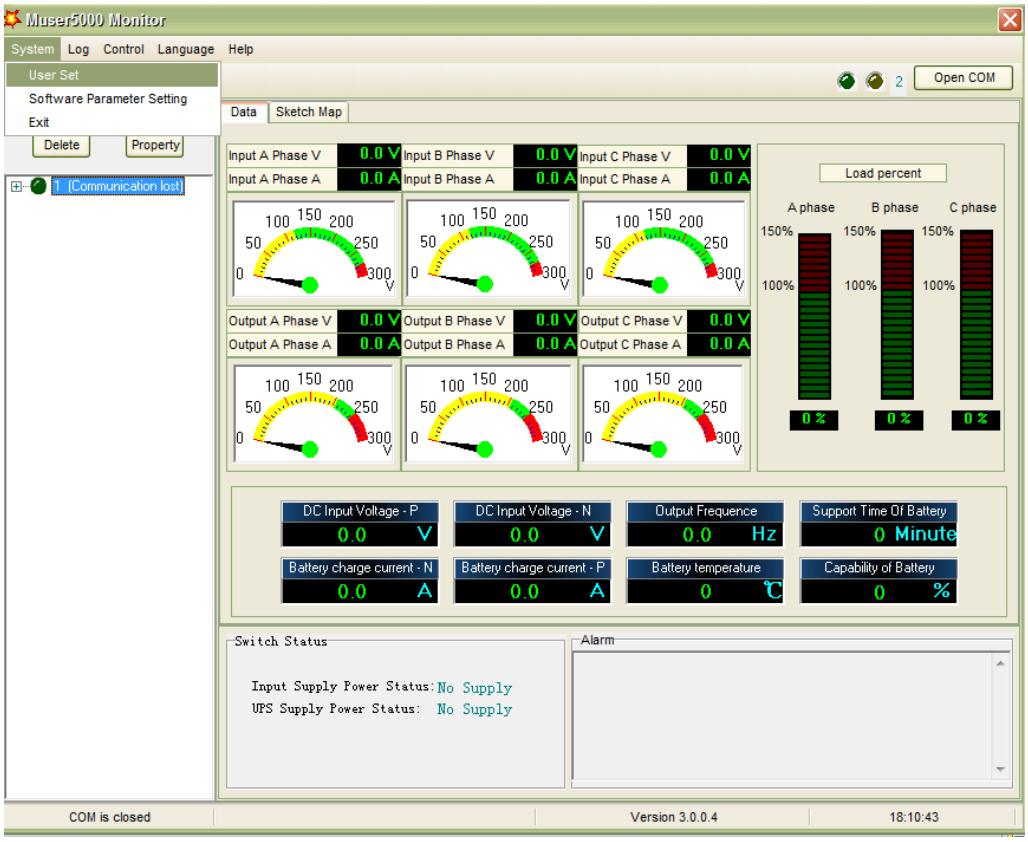


◆Click "Set" at "User Set" window. Password is YDC3350.

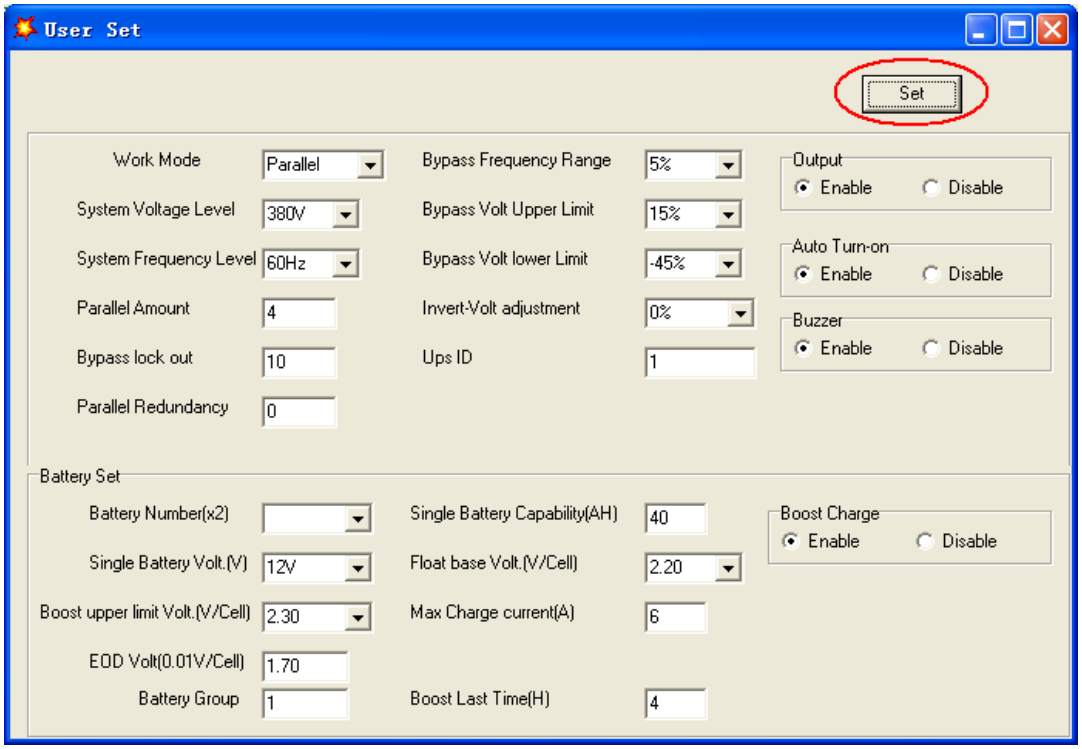

◆At the window of “Data Set”, click “Work Mode”,, choose “Parallel” for the value, then click “Set” as shown in below picture. If the UPS sounds a “beep”, that means the setting is correct.

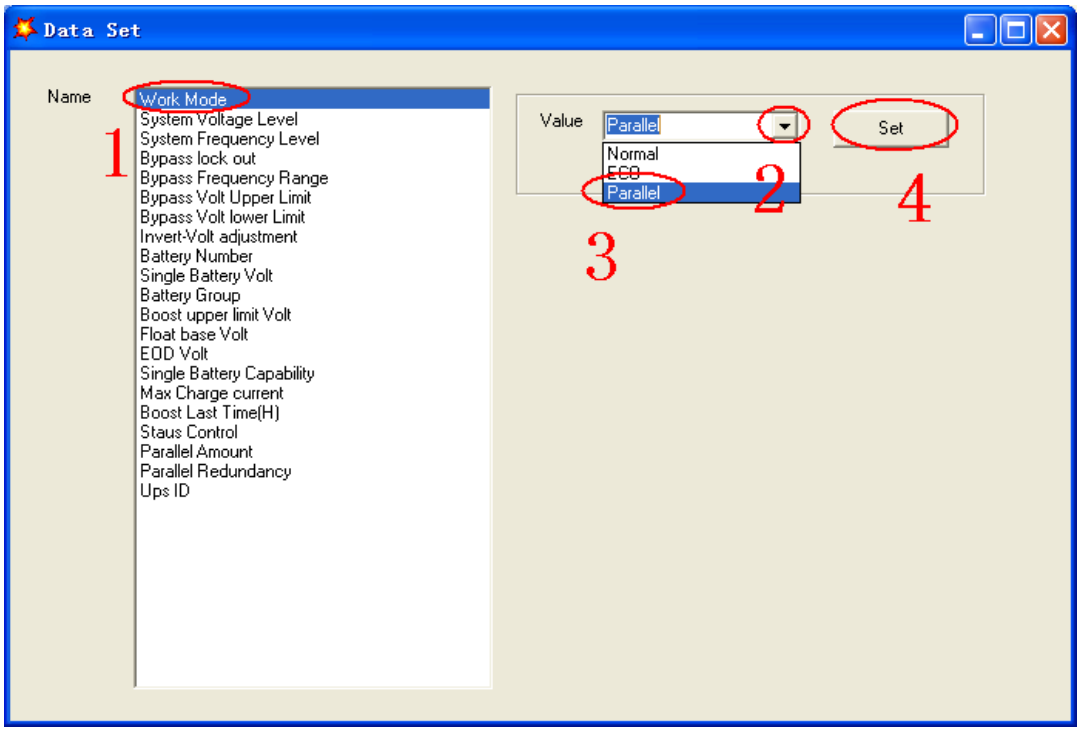

◆At the window of “Data Set”, click “Ups ID”, write a value for the parallel UPS ID at the right side, such as “1”, then click “Set” as shown in below picture. If the UPS sounds a “beep”, that means the setting is correct.

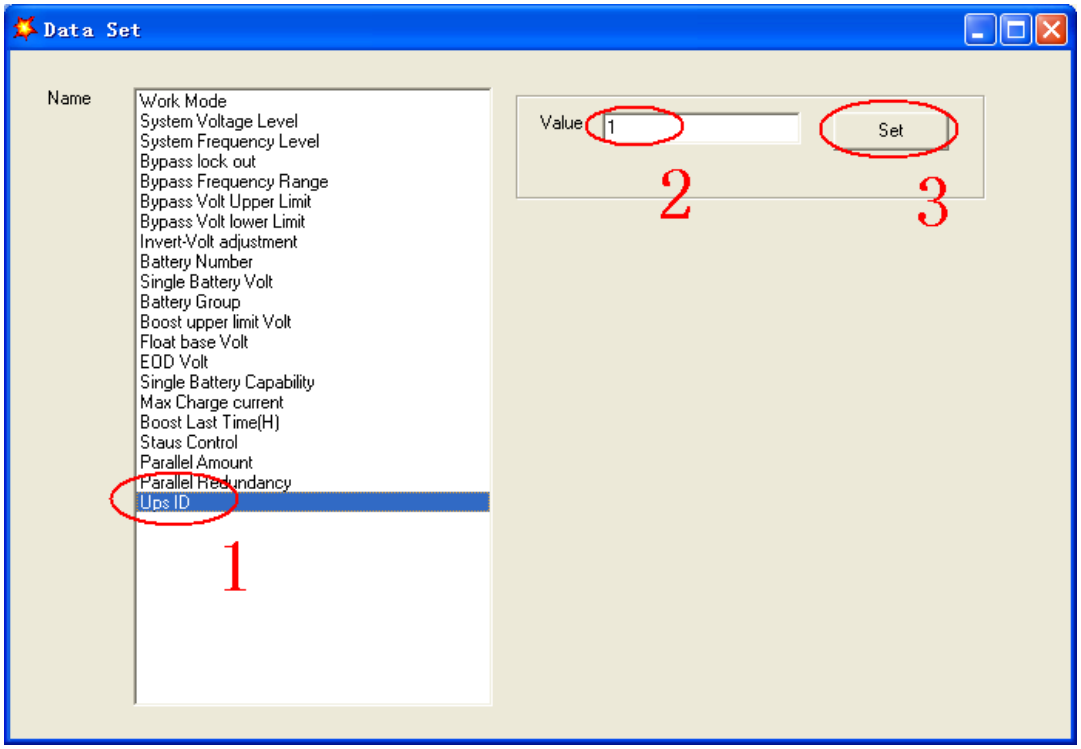

CAUTION!


After changing the parallel system ID, the connection between Muser5000 and equipment might be interrupted. If it occurs, please re-connect in accordance with the instruction described before.

CAUTION!

Parallel cable cannot be connected when setting the parallel parameters.

◆After setting the UPS needed to be paralleled, power off all the UPS. Connect all the UPS according to “parallel cable installation”, and then power on the UPS.

4.3 The LCD Display

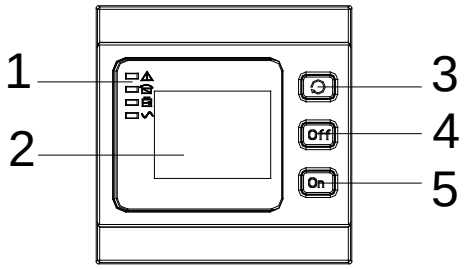

Overview of the operating panel of the UPS

(1) LED indicator

(2) LCD display

(3) Scroll button: enter to next item

(4) Off button


(5) On button

Introduction


CAUTION!

The display provides more functions than those described in this manual.


Main page : default display page

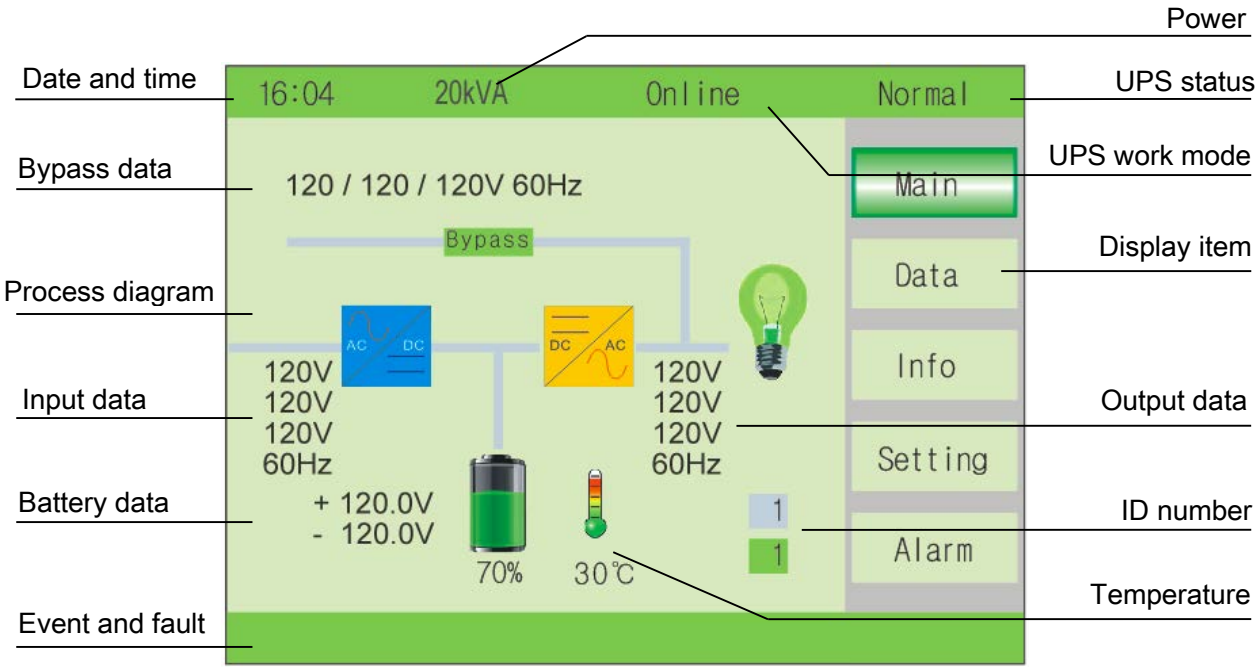


Data : press ↻ key for short time change to data item, the page display input data and output data

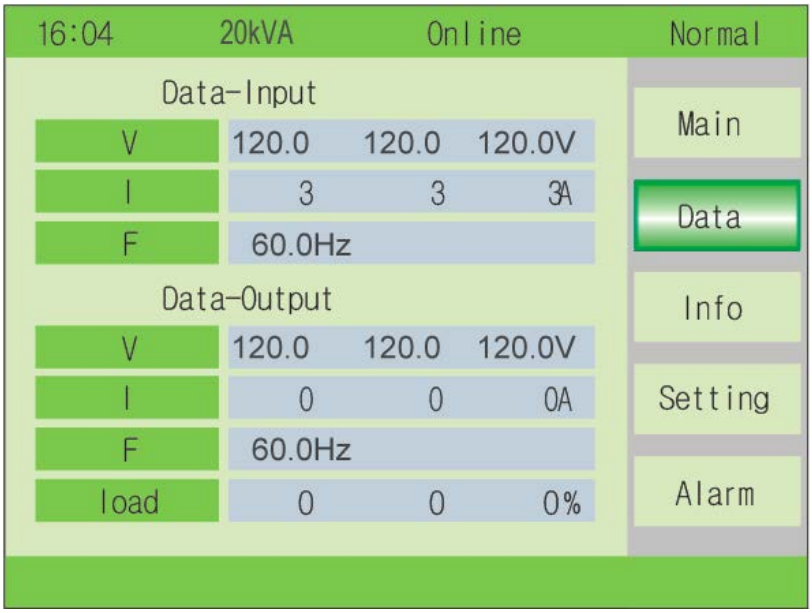


INPUT : press Off key for shot time to enter the data, the first page is mains input and bypass input data.

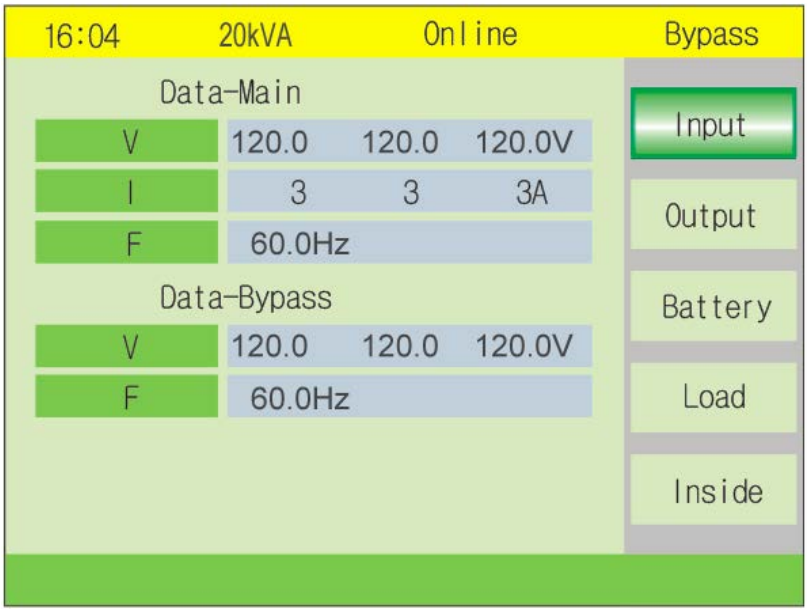


OUTPUT : press ↻ key for shot time to change item, the second page of data is Output data.

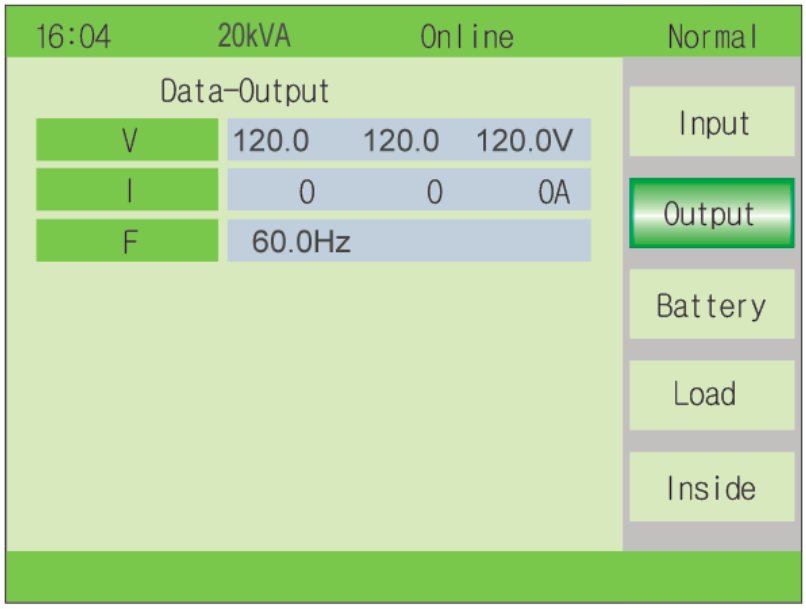


Battery : press key for short time to change item, the third page of data is Battery data.

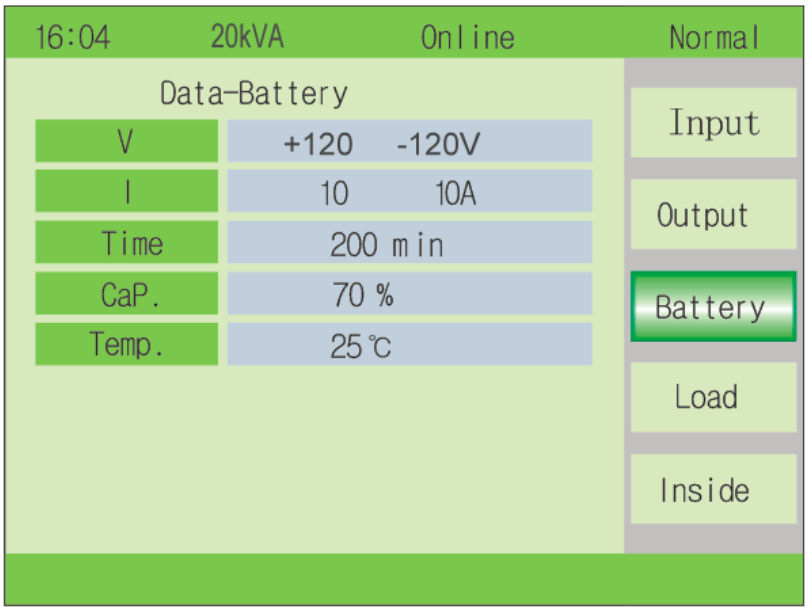

LOAD : press key for short time to change item, the fourth page of data is Load data.

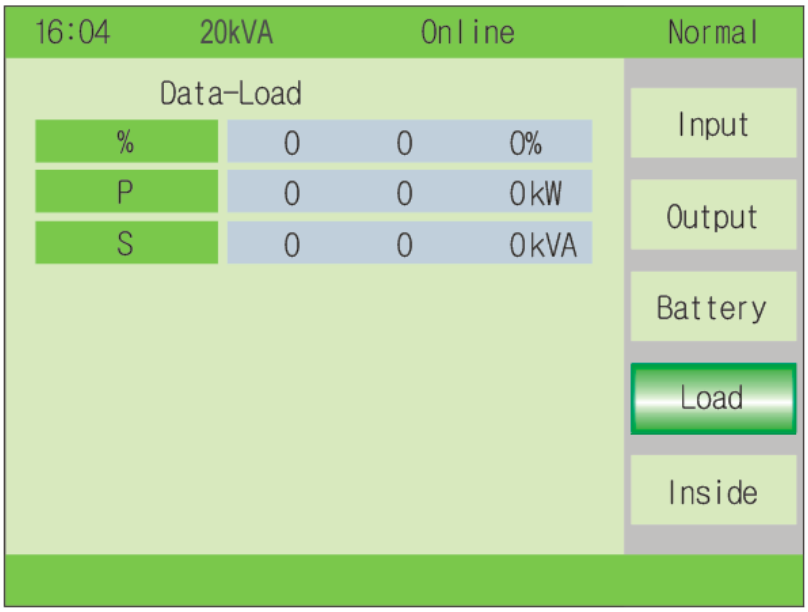

INFO : Press ↻ key for long time to exit data item, and press ↻ key for short time change to Info item, this page display the version of the LCD/LED and DSP. (The version of ECU only for 40-50k UPS)

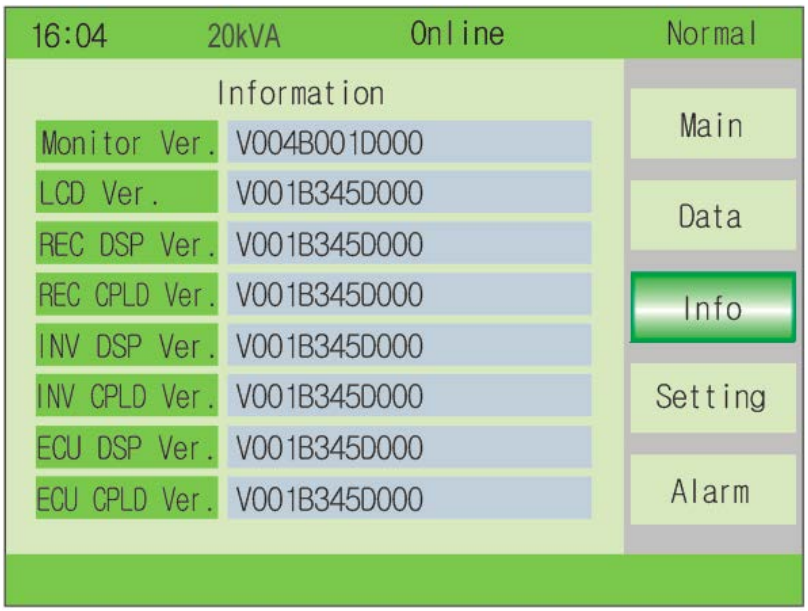

SETTING-User : press ↻ key for short time change to setting item, then press OFF key to enter setting-user page . Press ↻ key to change item, press off key to enter item and press ↻ key to change value, press OFF key confirm the setting.

Lang : Language display, default value is "English".

Date : date setting

Time : time setting

Backlight : backlight delay time setting, default value is "60s"

Buzzer : buzzer tweet or mute, default value is "tweet"


Test now : battery self-test, test 10 second, 10 minute or to eod, default value is "OFF"

Device ID : default value is "1"

Baud rate : can select 2400, 4800, 9600,14400, 19200 default value is "9600"



Maintenance : Press + off key to enter maintenance, then will display a password window, press change the number and press off to select the value, the password is “1121”.

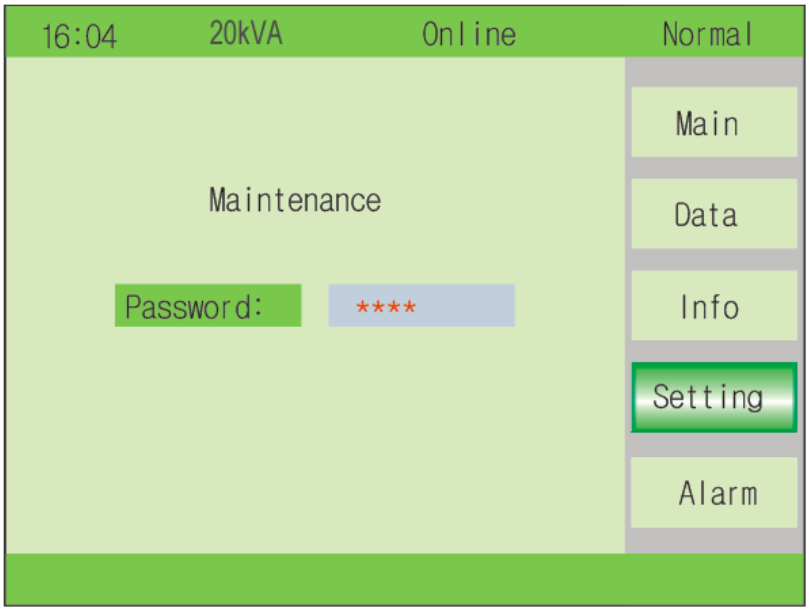

Maintenance-System : press OFF key to enter item and confirm value, press change value.

Work mode : Normal, Parallel, ECO, default value is "Normal"

V_Output Grade : 120/127, default value is "120"

F_Output Grade : 50 and 60, default value is "60"


F_mode : CVCF and Non-CVCF, default value is "Non-CVCF"

Test type : 10s, 10min and EOD, default value is "OFF"

Test Circle : 1~30 days

Temp. Sensor SW (10-20k): Default value is "OFF". Temperature sensor type select has two types: NTC and RS485. NTC for single and short distance. Rs485 for multiple and far distance.

O/P Volt : Inverter voltage Micro regulation, 0~±5%, step is 0.5%, default value is "0"

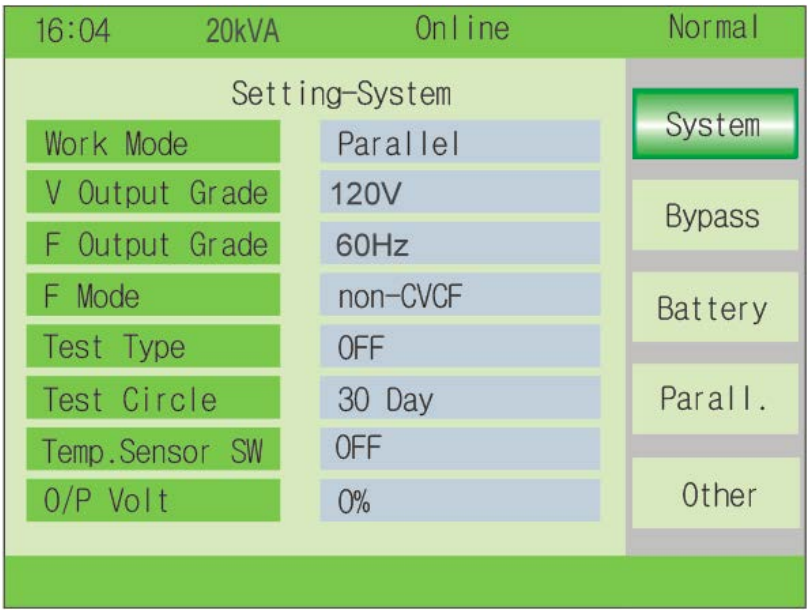


Maintenance-Bypass : press OFF key to enter item and confirm value, press ↻ change value.

Upper Limit : 10%, 15%, 20%, 25%, default value is "25%"

Lower Limit : -10%,-15%,-20%,-30%,-45%, default value is "-45%"

F_Range : 1%, 2%, 4%, 5%, 10%, default value is "10%"

Times of INV-BPS : 3~10, default value is "10"

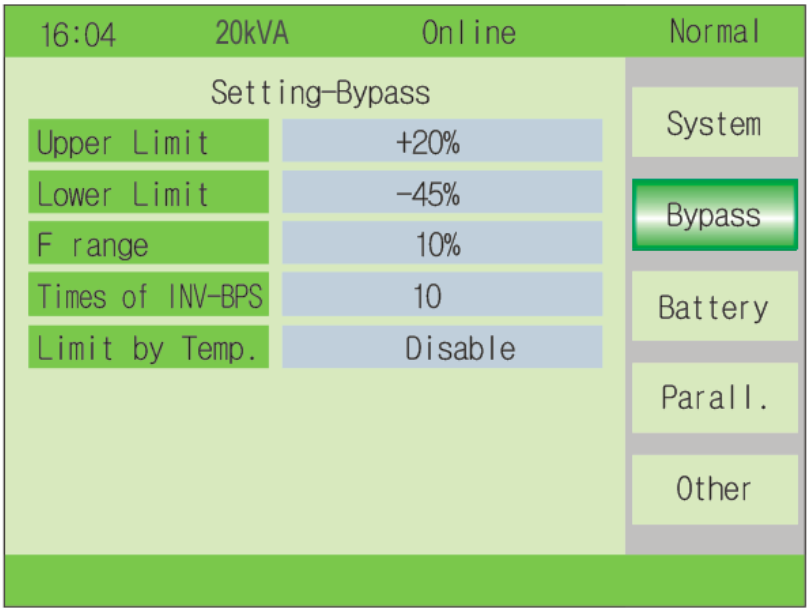

Maintenance-Battery : press OFF key to enter item and confirm value, press ↻ change value.

Number : 16/18/20/22/24/26pcs (8/9/10/11/12/13pcs for each “+” string and “-“ string.) default value is "20"

Capacity : 7~2000Ah

Boost charge : Enable or disable, default value is "Enable"


Group : 1~8, default value is "1"

V-Boost : 2.30~2.40, step is 0.01V, default value is "2.30"

V-Float : 2.20~2.29, step is 0.01V, default value is "2.25"

V-EOD :1.60V or 1.80V, step is 0.01V, default value is "1.8".(1.75 default for 10-20k)

I-Maxcharge : 0.05~0.15C

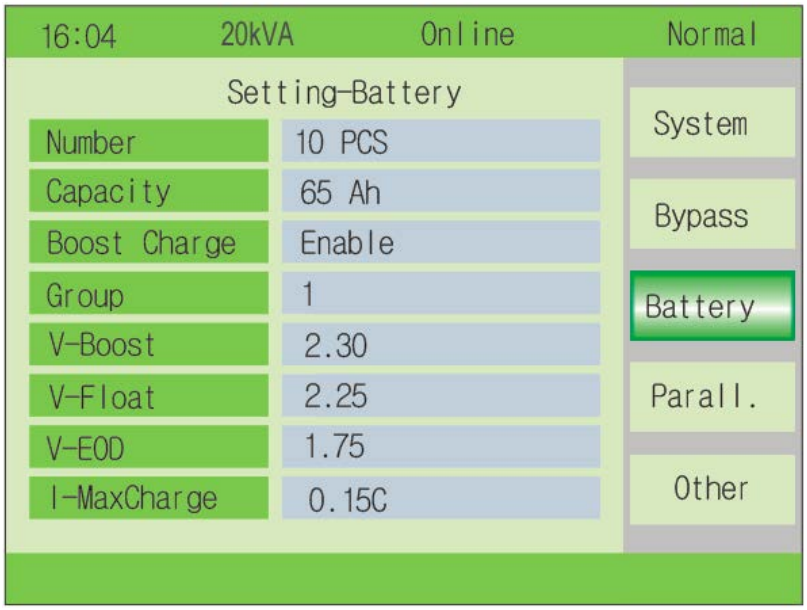


Maintenance-Parallel : This item can select after the work mode is set parallel. Press OFF key to enter item and confirm value, press ↻ change value.

ID : 1~4 for 10-20k; UPS ID. default value is "1"

Number : 2~4 for 10-20k; UPS parallel max number, default value is "2"

Redu. Num : 1~3 for 10-20k; Redundancy UPS number, default value is "0"

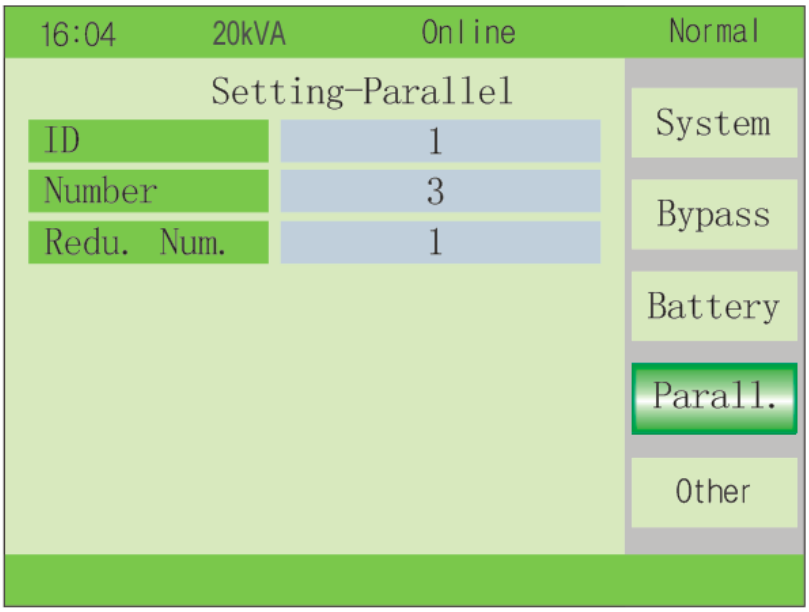

Maintenance-Other (10-20k): This item can select after the work mode is set parallel. Press OFF key to enter item and confirm value, press ↻ change value.

Fault Clear: Clear or Cancel, default value is “Cancel”. Clear means clear the current fault.


Boot Duration: Boost charge time limit, the value can be 1–999min, and is 240 by default.

Inter P Walk In: When UPSes are in parallel mode. this enables the UPS to control the interval that each UPS transfers from battery mode to normal mode, which reduces the impact on the generator or power grid. The value can be 1~200,

default value is 10.

Aging Load Rate: The value can be 18~100%，default value: 60.


Float/Boost Chg: Set up boost charge and float charge conversion time. The value can be 1~24，default value is OFF.

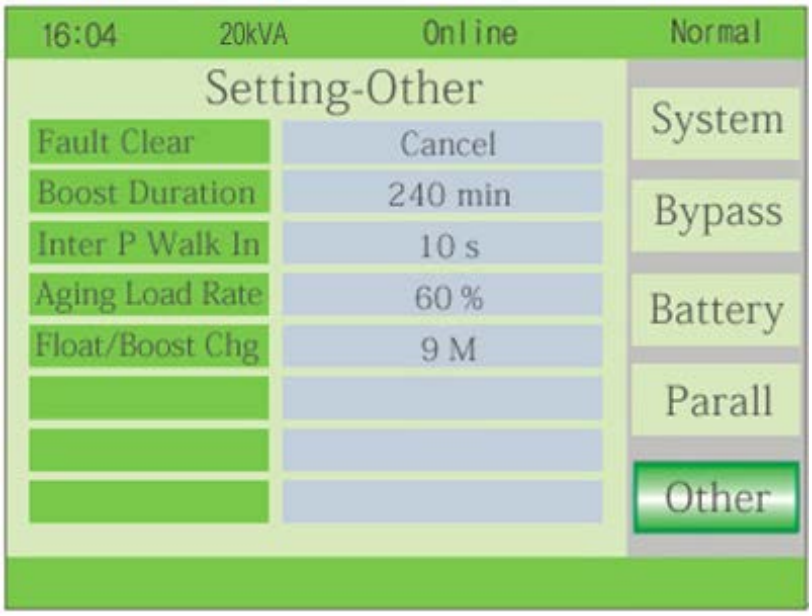

.

Device ID : 1~15. UPS communication ID. default value is "1"

Baud rate: 2400, 4800, 9600, 14400, 19200, default value is "9600"

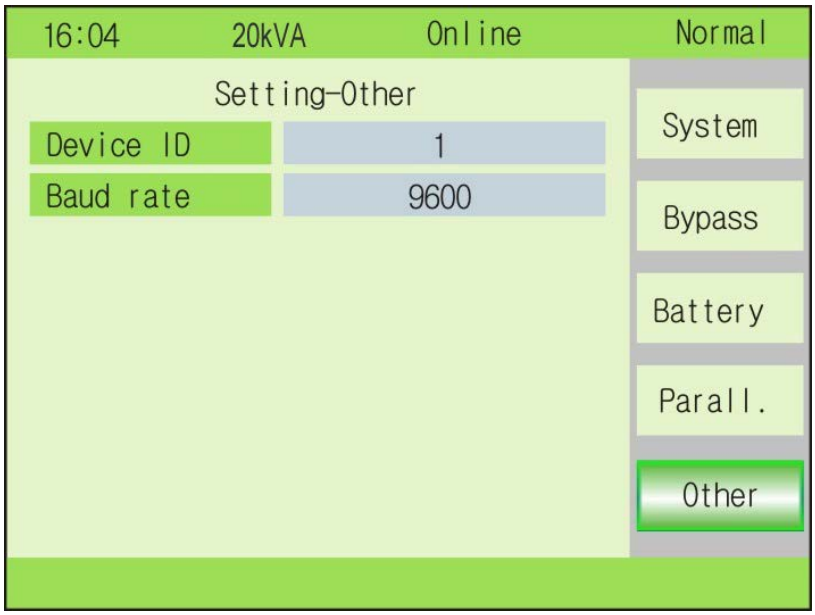

Maintenance-Dry (10-20k): This item can select after the work mode is set parallel. Press OFF key to enter item and confirm value, press ↻ change value.

INPUT dry contact:

Contain a total of 4 input dry contacts. User can choose different function for IN 01~04.

Each dry contact has 16 functional options, including INV ON, INV OFF, BATT Fault, Generator, User Alarm3, User Alarm4, Forbidden ECO, Force INV OFF, Input Switch, Bypass Switch, BATT Switch, BATT Trip, BATT Ground, Thunder, EPO, Close.

IN 01: The default value is INV ON.

IN 02: The default value is INV OFF.

IN 03: The default value is Close.

IN 04: The default value is Close.

OUTPUT dry contact:

Contain a total of 4 input dry contacts. User can choose different function for IN 01~04. And choose Normally Closed (OFF)/ Normally Opened (ON), the default value is Normally opened.


Each dry contact has 16 functional options, including UPS Warning, Online Mode, Battery Mode, Bypass Mode, INV Overload, Fan Fault, BATT Fault, BATT Disconnect, BATT Low Volt, Mains Abnormal, BYP Not Available, EPO, Maint Mode, Parallel Comm Fault, ECO Mode, Close.

OUT 01: The default value is UPS Warning. Normally Opened (ON)


OUT 02: The default value is Bypass Mode. Normally Opened (ON)

OUT 03: The default value is BATT Low Volt. Normally Opened (ON)

OUT 04: The default value is Online Mode. Normally Opened (ON)

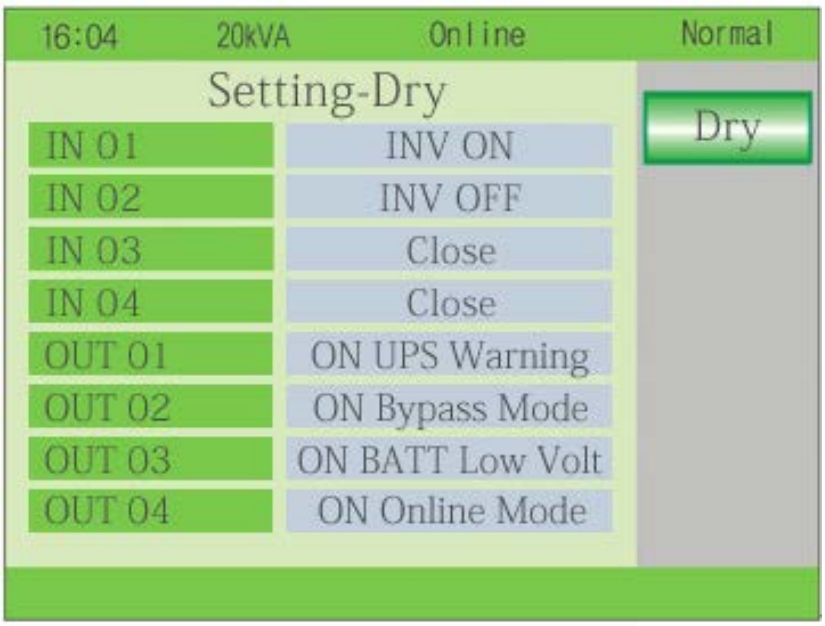

Alarm : Contain alarm record and event record

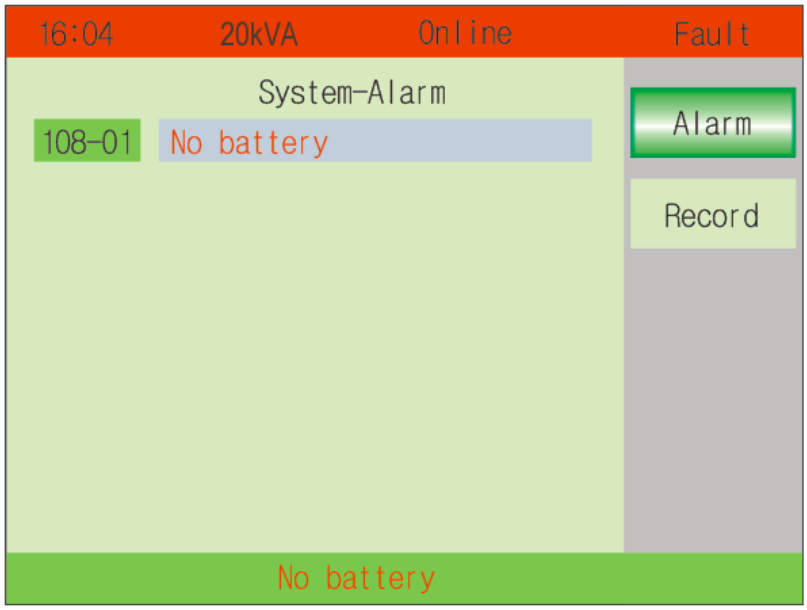



4.4 Display Messages/Troubleshooting

This section lists the event and alarm messages that the UPS might display. The messages are listed in alphabetical order. This section is listed with each alarm message to help you troubleshoot problems.

Display messages

Operational Status and Mode(s)

No.	Information stand for	LED			
		Fault	Bypass	Battery	Inverter
1	Initialized	**EXTINGUISH**	**EXTINGUISH**	**EXTINGUISH**	**EXTINGUISH**
2	Standby Mode	**EXTINGUISH**	**EXTINGUISH**	X	**EXTINGUISH**
3	No Output	**EXTINGUISH**	**EXTINGUISH**	X	**EXTINGUISH**
4	Bypass Mode	**EXTINGUISH**	**LIGHT**	X	**EXTINGUISH**

5	Utility Mode	**EXTINGUISH**	**EXTINGUISH**	X	**LIGHT**
6	Battery Mode	**EXTINGUISH**	**EXTINGUISH**	**LIGHT**	**EXTINGUISH**
7	Battery Self-diagnostics	**EXTINGUISH**	**EXTINGUISH**	**LIGHT**	**EXTINGUISH**
8	Inverter is starting up	**EXTINGUISH**	X	X	**EXTINGUISH**
9	ECO Mode	**EXTINGUISH**	X	X	X
10	EPO Mode	**LIGHT**	**EXTINGUISH**	X	**EXTINGUISH**
11	Maintenance Bypass Mode	**EXTINGUISH**	**EXTINGUISH**	**EXTINGUISH**	**EXTINGUISH**
12	Fault Mode	**LIGHT**	X	X	X

CAUTION : "X" means it is determined by other conditions

Fault Information

No	Fault Cord	UPS Alarm Warning	Buzzer	LED
1	002	REC Over Temperature	Twice per second	Fault LED lit
2	003	REC par. cable Fault	Twice per second	Fault LED lit
3	004	REC Over Current	Beep continuously	Fault LED lit
4	005	REC Power Fault	Beep continuously	Fault LED lit
5	007	Input SCR Fault	Beep continuously	Fault LED lit
6	00A	Battery SCR Fault	Beep continuously	Fault LED lit
7	00C	Charge SCR Fault	Beep continuously	Fault LED lit
8	00E	Fan Fault	Beep continuously	Fault LED lit
9	011	Fan Power fault	Beep continuously	Fault LED lit
10	012	Charger Over Temp.	Beep continuously	Fault LED lit
11	013	Soft Start Failed	Beep continuously	Fault LED lit
12	014	BAT Charger Fault	Beep continuously	Fault LED lit
13	016	REC Comm. Fault	Once per 2 seconds	Fault LED blinking
14	019	REC Initializes Fault	Beep continuously	Fault LED lit
15	01D	Unit insert fault	Once per 2 seconds	Fault LED lit
16	063		Once per 2 seconds	Fault LED lit
17	01E	Rectifier Fault	Beep continuously	Fault LED lit
18	041	Inverter Fault	Beep continuously	Fault LED lit
19	044	INV IGBT SHORT	Beep continuously	Fault LED lit
20	047	Inverter relay Short	Beep continuously	Fault LED lit
21	04A	Inverter relay Broken	Beep continuously	Fault LED lit
22	04D	INV par. cable Fault	Twice per second	Fault LED lit
23	051	Output Short Circuit	Once per second	Fault LED blinking
24	054	INV Comm. Fault	Once per 2 seconds	Fault LED blinking
25	057	INV Initializes Fault	Beep continuously	Fault LED lit

No	Fault Cord	UPS Alarm Warning	Buzzer	LED
26	05A	INV self-test Fault	Beep continuously	Fault LED lit
27	05E	DC Component Fault	Once per 2 seconds	Fault LED lit
28	061	DC bus abnormal	Beep continuously	Fault LED lit
29	064	INV DSP Power Fault	Beep continuously	Fault LED lit
30	067	INV Over Temperature	Twice per second	Fault LED lit
31	068	Load Sharing Fault	Twice per second	Fault LED lit
32	06A	Cabinet mode Fault	Beep continuously	Fault LED lit
33	06B	Fuse Broken	Beep continuously	Fault LED lit
34	081	Par. cable Fault	Twice per second	Fault LED lit
35	086	ECU Insert Fault	Once per 2 seconds	Fault LED lit
36	088	ECU Power Fault	Beep continuously	Fault LED lit
37	08B	ECU Comm. Fault	Beep continuously	Fault LED lit
38	08D	ECU Initializes Fault	Once per 2 seconds	Fault LED blinking
39	091	Bypass SCR Broken	Beep continuously	Fault LED lit
40	0C2		Beep continuously	Fault LED lit
41	094	Bypass SCR short	Beep continuously	Fault LED lit
42	0C5		Beep continuously	Fault LED lit
43	097	BPS Over Temperature	Beep continuously	Fault LED lit
44	0CF		Beep continuously	Fault LED lit
45	09A	Output CT Reverse	Beep continuously	Fault LED lit
46	09D	Bypass Feedback Fault	Beep continuously	Fault LED lit

Alarm Information

No	Alarm Cord	UPS Alarm Warning	Buzzer	LED
1	103	Battery Over Voltage	Once per second	BATTERY LED blinking
2	104	BAT Low Pre-warning	Once per second	BATTERY LED blinking
3	105	Battery Reverse	Twice per second	BATTERY LED blinking
4	106	Battery EOD	Once per second	BATTERY LED blinking
5	107	Battery Voltage low	Once per second	BATTERY LED blinking
6	108	No Battery	Once per second	BATTERY LED blinking
7	109	Input Phase Reverse	Once per second	INVERTER LED blinking
8	10A	Input N-Line lost	Twice per second	INVERTER LED blinking
9	10B	Mains Freq. Abnormal	Once per 2 seconds	INVERTER LED blinking
10	10C	Mains Volt. Abnormal	Once per 2 seconds	INVERTER LED blinking
11	10D	REC Comm. Error	Once per 2 seconds	INVERTER LED blinking
12	10E	Mains input lost	Once per 2 seconds	
13	10F	Set Data Err.	Once per 2 seconds	FAULT LED blinking

No	Alarm Cord	UPS Alarm Warning	Buzzer	LED
14	121	INV Par. cable abnormal	Once per 2 seconds	FAULT LED blinking
15	125	INV Overload	Once per 2 seconds	INVERTER LED blinking
16	126	INV not synchronized	Beep continuously	INVERTER LED blinking
17	12A	INV Set Data Err	Once per 2 seconds	FAULT LED blinking
18	129	INV Comm. Error	Once per 2 seconds	FAULT LED blinking
19	141	Bypass Switch to Num	Once per 2 seconds	BYPASS LED blinking
20	142	Unit quantity mismatch	Once per 2 seconds	FAULT LED blinking
21	143	Parallel Overload	Once per 2 seconds	INVERTER LED blinking
22	144	Bypass Overload	Once per 2 seconds	BYPASS LED blinking
23	145	Maint. Switch Misuse	Once per 2 seconds	FAULT LED blinking
24	146	ECU Comm. Error	Once per 2 seconds	FAULT LED blinking
25	147	Par. cable abnormal	Once per 2 seconds	FAULT LED blinking
26	14B	ECU Par. cable abnormal	Once per 2 seconds	FAULT LED blinking
27	14C	ECU Abnormal	Once per 2 seconds	FAULT LED blinking
28	14E	BPS Phase Reversed	Once per second	BYPASS LED blinking
29	162		Once per second	BYPASS LED blinking
30	14F	BPS Unable To Trace	Once per 2 seconds	BYPASS LED blinking
31	163		Once per 2 seconds	BYPASS LED blinking
32	150	BPS Not Available	Once per second	BYPASS LED blinking
33	164		Once per second	BYPASS LED blinking
34	151	Ecu Set Data Err	Once per 2 seconds	FAULT LED blinking

4.5 Options


SNMP card: internal SNMP / external SNMP optional

- Loosen the 2 torque screws (on each side of the card).
- Carefully pull out the card. Reverse the procedure for re-installation

The slot called SNMP supports the MEGAtec protocol. We advise that NetAgent II-3 port is also a tool to remotely monitor and manage any UPS system

NetAgent II-3Ports supports the Modem Dial-in (PPP) function to enable the remote control via the internet when the network is unavailable.

In addition to the features of a standard NetAgent Mini, NetAgent II has the option to add NetFeeler Lite to detect temperature, humidity, smoke and security sensors. Thus, making NetAgent II a versatile management tool. NetAgent II also supports multiple languages and is setup for web-based auto language detection.

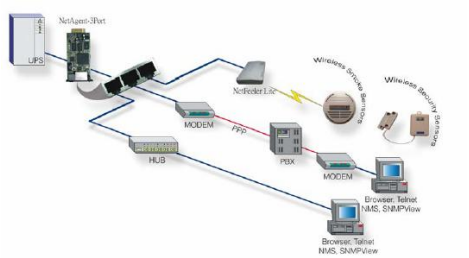

Typical topology of the UPS Network Management

Appendix 1 Specifications

Model			10kVA	15kVA	20kVA
Capacity (VA/Watts)			10k / 10k	15k / 15k	20k / 20k
INPUT					
Rectifier input	Rated AC Input Voltage		208/120Vac or 220/127Vac, 50/60Hz, 3-Phase, 4-Wire Plus Ground		
	Input Voltage Range (Startup/Operating)		-20%, +25% (96-150Vac or 102-159Vac), Full load		
	Input Voltage Range (Operating)		-40%, +25% (72-150Vac or 76-159Vac) , <50% Load		
	Frequency		50 or 60Hz (40-70Hz Range)		
	Power Factor		0.99 (40% linear load)		
	Harmonic distortion (THDi)		≤2% (100% nonlinear load)		
Bypass input	Rated AC Voltage		208/120Vac or 220/127Vac, 50/60Hz, 3-Phase, 4-Wire Plus Ground		
	Bypass voltage Range		Upper limit: +10,+15,+20 or 25% (default:+20)		
			Lower limit:-10,-20,-30 or -40 (default:-30)		
	Bypass frequency Range		±10%		
	Synchronization - Window		±1%/±2%/±4%/±5%/±10% optional (default:±10%)		
	Max current (A)		Breaker50A	Breaker63A	Breaker 80A
	Upstream protection, bypass line		Thermomagnetic circuit-breaker, rated up to 125% of nominal output current. IEC 60947-2 curve C.		
	Current rating of neutral cable (A)		1.7×In		
Generator Input			Support		
OUTPUT					
Inverter Output	Power factor		1.0		
	Rated AC Voltage 1		208/120Vac or 220/127Vac, 50/60Hz, 3-Phase, 4-Wire Plus Ground		
	Voltage Regulation		±1%		
	Transient Voltage Response		±5% (linear load)		
	Phase Balance		120° ±1° (100% unbalanced load)		
	Frequency		1.Line Mode: synchronize with input; when input frequency > ±10% (±1%/±2%/±4%/±5% optional), output (50/60±0.1%)Hz. 2.Battery Mode:(50/60±0.1%)Hz		
	Crest factor		3:1		
	Harmonic distortion (THD)		< 1% (linear load), <3% (non linear load)		
	Overload Capacity	AC Mode	Load≤110%: last 60min , ≤125%: last 10min , ≤150%: last 1min , > 150% turn to bypass immediately		
		Bat. Mode	Load≤110%: last 10min , ≤125%: last 1min , ≤150%: last 5S , > 150% shut down UPS immediately		
Efficiency	Normal mode		Up to 94%		
BATTERY					

Battery	Battery voltage	Optional Voltage: ±96V\±108V\±120V\±132V\±144V\±156dc(16/18/20/22/24/26pcs optional) 240Vdc~312Vdc (20~26 pcs, no power derating; 16 pcs output power factor 0.8)		
	Float Voltage	2.25V/cell (selectable from 2.20-2.29V/cell) Constant current and constant voltage charge mode		
	Boost Charge Voltage	2.30V/cell (selectable from 2.30-2.40V/cell) Constant current and constant voltage charge mode		
	End of Discharge	1.75 V/cell (selectable from 1.60 or 1.90V/cell)		
	Charge Current(A) (charge current can be set according to battery capacity installed)	Standard unit: 1.35A (2.7;4.05A optional) Long run unit: Max. current 20A (limited by input current)	Standard unit: 2.7A (4.05A optional) Long run unit: Max. current 20A (limited by input current)	Standard unit: 4.05A Long run unit: Max. current 20A (limited by input current)
SYSTEM FEATURES				
Transfer Time	Synchronous transfer	Utility to Battery : 0ms; Utility to bypass: 0ms		
	Asynchronous transfer	Asynchronous transfer: 15ms (50 Hz), 13.3ms (60 Hz)		
Alarms		overload, utility abnormal, UPS fault, battery low, etc.		
Protection		short circuit, overload, over temperature, battery low, fan fault alarm.		
Communication Interface		USB, RS232,RS485, Parallel port, Dry contact, Intelligent slot, SNMP card (optional), Relay card (optional),Battery temperature sensor(optional)		
ENVIRONMENTAL				
Environment	Operating Temperature	0℃ ~ 40℃		
	Storage Temperature	-25℃ ~ 55℃(no battery)		
	Humidity	0 ~ 95% non condensing		
	Acoustical Noise	<55dB from 1M distance		<58dB from 1M distance
	Altitude	< 1500m.When>1500m,lower the rated power for use		
PHYSICAL				
Dimension D×W×H (mm)		670×440×130(3U)		
Net weight (Kg)		25 ~ 28		
STANDARDS				
Safety certifications		UL 1778, IEC/EN 62040-1, IEC/EN 60950-1		
EMC		FCC Part 15:2015, IEC/EN62040-2, IEC61000-4-2, IEC61000-4-3, IEC61000-4-4, IEC61000-4-5, IEC61000-4-6, IEC61000-4-8		

Appendix 2 Problems and Solution

In case the UPS cannot work normally, it might be wrong in installation, wiring or operation. Please check these aspects first. If all these aspects are checked without any problem, please consult with local agent right away and provide below information.

（1）Product model name and serial number.

（2）Try to describe the fault with more details, such as LCD display info, LED lights status, etc.


Read the user manual carefully, it can help a lot for using this UPS in the right way. Some FAQ (frequently asked questions) may help you to troubleshoot your problem easily.

No.	Problem	Possible reason	Solution
1	Utility is connected but the UPS cannot be powered ON.	Input power supply is not connected; Input voltage low; The input switch of the UPS is not switched on.	Measure if the UPS input voltage/frequency is within the window. Check if UPS input is switched on
2	Utility normal but Utility LED does not light on, and the UPS operates at battery mode	The input breakers of the UPS are not switched on; input cable is not well connected	Switch on the input breaker; Make sure the input cable is well connected.
3	The UPS does not indicate any failure, but output do not have voltage	Output cable does not well connected; Output breaker do not switch on	Make sure the output cable is well connected; Switch on the output breaker.
4	Utility LED is flashing	Utility voltage exceeds UPS input range.	If the UPS operates at battery mode, please pay attention to the remaining backup time needed for your system.
5	Battery LED is flashing but no charge voltage and current	Battery breaker does not switch on, or batteries are damaged, or battery is reversely connected. Battery number and capacity are not set correctly.	Switch on the battery breaker. If batteries are damaged, need to replace whole group batteries, Connect the battery cables correctly; Go to LCD setting of the battery number and capacity, set the correct data.
6	Buzzer beeps every 0.5 seconds and LCD display “output overload”	Overload	Remove some load
7	The UPS only works on bypass mode	The UPS is set to ECO mode, or the transfer times to bypass mode are limited.	Set the UPS working mode to UPS type(non-parallel) or to reset the times of transferring to bypass or re-start the UPS
8	Cannot Black start	Battery switch is not properly closed:	Close the battery switch: Change the fuse:

		Battery fuse is not open: Or Battery low: Battery quantity set wrong; Power breaker in the rear panel not switch ON.	Recharge the battery: Power ON the UPS with AC to set the battery quantity &quantity; Switch on the power breaker.

Appendix 3 USB communication port definition

Definition of port：



Connection between PC USB port and UPS USB port.

PC USB port	UPS USB port	Description
Pin 1	Pin 1	PC : +5V
Pin 2	Pin 2	PC : DPLUS signal
Pin 3	Pin 3	PC :DMINUS signal
Pin 4	Pin 4	Signal ground

Available function of USB

- Monitor UPS power status.
- Monitor UPS alarm info.
- Monitor UPS running parameters.
- Timing off/on setting.

Communication data format

Baud rate ---------- 9600bps

Byte length ---------- 8bit

End bit ---------- 1bit


Parity check ---------none

CAUTION!

USB and RS232 interface cannot be used at the same time, you can only use one of them at one time.

Appendix 4 RS232 communication port definition

Definition of Male port：



Connection between PC RS232 port and UPS RS232 port

PC RS232 port	UPS RS232 port	
Pin 2	Pin 2	UPS send,PC receive
Pin 3	Pin 3	PC send,UPS receive
Pin 5	Pin 5	ground

Available function of RS232

- Monitor UPS power status.
- Monitor UPS alarm info.
- Monitor UPS running parameters.
- Timing off/on setting.

RS-232 communication data format

Baud rate ---------- 9600bps

Byte length ---------- 8bit

End bit ---------- 1bit


Parity check ---------none

CAUTION!

USB and RS232 interface cannot be used at the same time, you can only use one of them at one time.

Appendix 5 RS485 communication port definition

Definition of port：

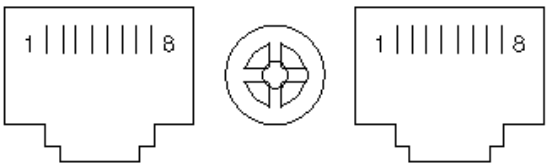

Connection between the Device's RS485 port and UPS RS485 port.

	device(RJ45)	UPS(RJ45)	Description
10-20kVA	Pin 1	Pin 1	485+ "A"
	Pin 2	Pin 2	485 -"B"
	Pin 7	Pin 7	12V
	Pin 8	Pin 8	GND

Available function of RS485

- Monitor UPS power status.
- Monitor UPS alarm info.
- Monitor UPS running parameters.
- Timing off/on setting.
- Battery environment temperature monitoring.
- Charging voltage modulation depending on batteries temperature

Communication data format

Baud rate ---------- 9600bps

Byte length ---------- 8bit

End bit ---------- 1bit

Parity check ---------none




CAUTION!

RS485 port pin7 is 12Vdc!

Appendix 6 Dry contact port definition

10-20kVA:

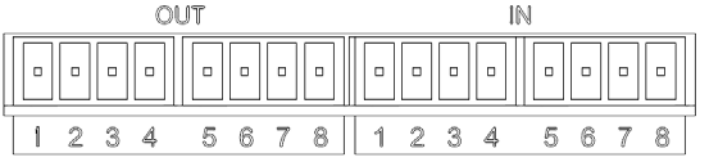

Input Dry Contact Interface

Port	Name	Specification	Function
IN-1	Input_contact_1	12V	INV ON, function can select on LCD
IN-2	GND	GND	Input dry contact signal GND
IN-3	Input_contact_2	12V	INV OFF, function can select on LCD
IN-4	GND	GND	Input dry contact signal GND
IN-5	Input_contact_3	12V	Close, function can select on LCD
IN-6	GND	GND	Input dry contact signal GND
IN-7	Input_contact_4	12V	Close, function can select on LCD
IN-8	GND	GND	Input dry contact signal GND


Output Dry Contact Interface

Port	Name	Specification	Function
OUT-1	Output_1_RLY	125Vac/0.5A	UPS Warning, function can select on LCD
OUT-2	Output_1_RLY_C	125Vac/0.5A	Output_1 dry contact port common pin
OUT-3	Output_2_RLY	125Vac/0.5A	Bypass Mode, function can select on LCD
OUT-4	Output_2_RLY_C	125Vac/0.5A	Output_2 dry contact port common pin
OUT-5	Output_3_RLY	125Vac/0.5A	BATT Low Volt, function can select on LCD
OUT-6	Output_3_RLY_C	125Vac/0.5A	Output_3 dry contact port common pin
OUT-7	Output_4_RLY	125Vac/0.5A	Online Mode, function can select on LCD
OUT-8	Output_4_RLY_C	125Vac/0.5A	Output4 dry contact port common pin

Appendix 7 Backfeed protection port definition

10-20kVA:

Definition of Male port:



Instruction:

UPS	Instruction	Function
Pin1/Pin2	Normally NC	Bypass Backfeed Port
Pin3/Pin4	Normally NC	Mains Backfeed Port


Function description:

- Pin1/2: Drive the Bypass breaker when Backfeed alarm.
- Pin3/4: Drive the Mains breaker when Backfeed alarm.

Appendix 8 REPO instruction

Definition of port：

Connection diagram：

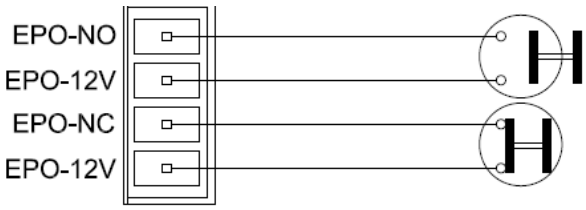


Connection between the button and UPS REPO port.

Button	UPS REPO	Description
Pin 1	Pin 1	EPO-NO
Pin 2	Pin 2	EPO-12V
Pin 1	Pin 3	EPO-NC
Pin 2	Pin 4	EPO-12V


- A remote emergency stop switch can be installed in a remote location and connection through simple wires to the REPO connector.

Appendix 9 Sub rack UPS dimension

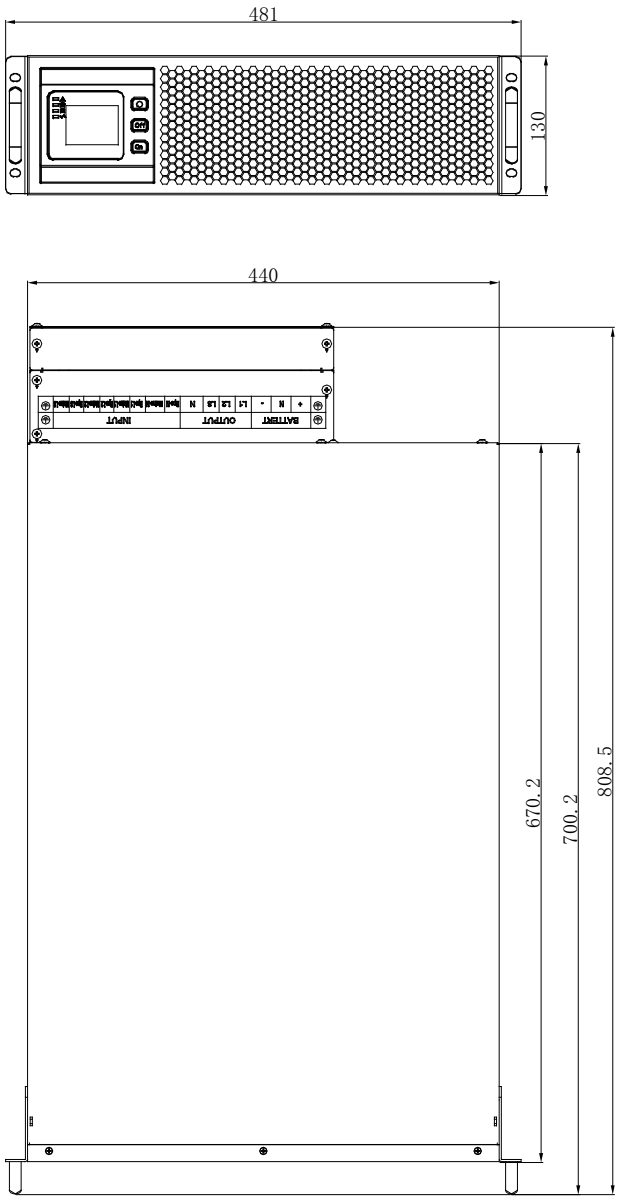


10/15/20kVA

Appendix 10 Tower UPS dimension

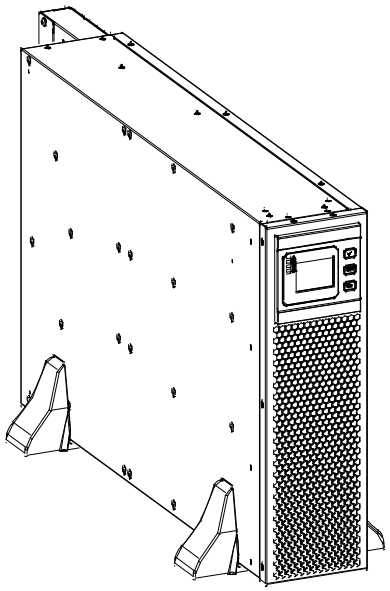


10/15/20kVA


10/15/20kVA:

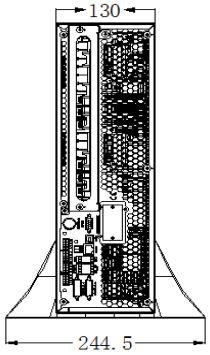

Rear view

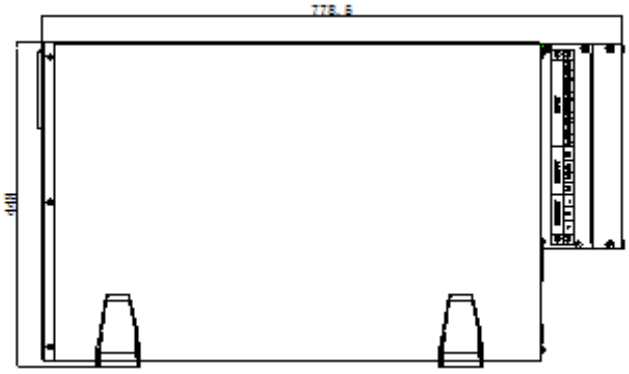

Side view

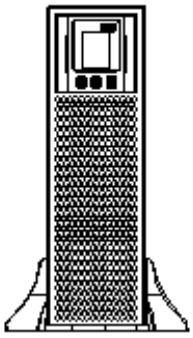

Front view