

Main power supply (100~240 VAC) ,Main power supply pipe, φ > 30mm
100~240VAC power supply cable 3 x 16awg , 2m above the ground reserved , must make grounded


Weak current tubes, including switch network cables (recommended network cable specifications are CAT5E/CAT6)
The inner diameter of the weak current tube should not be less than 30mm

The blank area is a hollow part, which can also be used as a grooved outlet


#17 Use M12×120 expansion bolt to fix

1. The gate must be installed on level ground
2. If the cables need to be routed on the same side of the device, the strong electrical conduits and the weak electrical conduits must be routed separately to ensure that they do not interfere with each other.
3. If the connecting wire is already full of peripherals, you need to use other wires to connect other peripherals separately, and increase the pipe diameter or re-groove
4. It hasn't built-in 5-ports network switch from manufacture
5. Interconnecting cables is 3m long
6. Please operate in a power-off state.


最大读卡器尺寸：	95*100*13.5mm（定制需重新评估刷卡性能，且无掌纹配置下才行）
Card reader or antenna space dimension:	

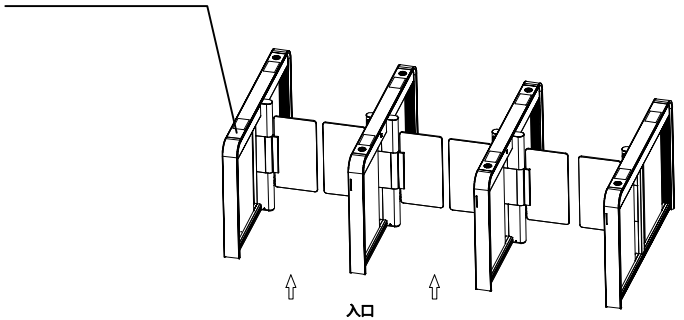

入口

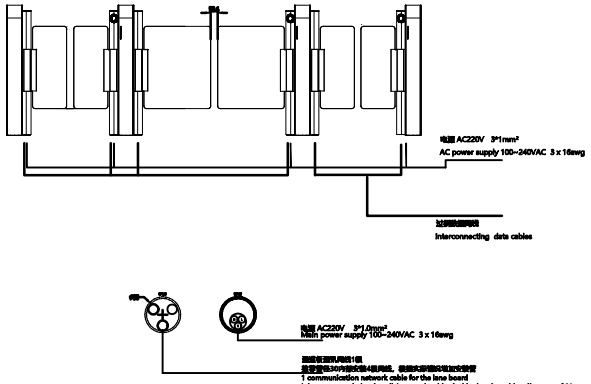


1 communication network cable for the lane board
It is recommended to install 4 network cables inside the pipe with a diameter of 30mm, and add more installation pipes according to the actual situation.

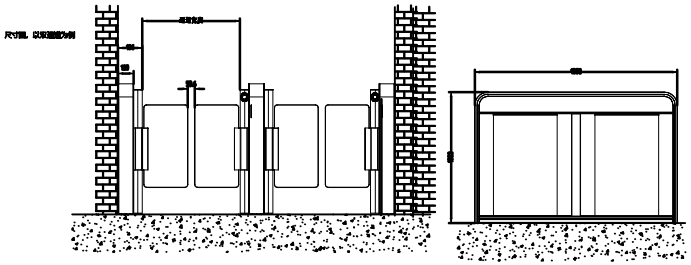

正视图 FRONT VIEW

侧视图 SIDE VIEW

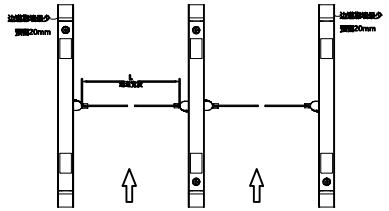

入口 outside

俯视图 PLAN VIEW

符合RoHS要求(Conform to the requirements of the RoHS).

<1>							
NO.	REV	DESCRIPTION 修改记录				ASSN	BY	DATE
DESIGN		PART NAME:		PART NO:			
APPROVED		DWG NO:		QTY: 1	SCALE: NTS		
STANDARD		MATERIAL:		WEIGHT:	SHEET:	FRONT DOOR	SCALE 1:1	SIZE: A1
SCALE		FINISH:		FRONT_DOOR_GP				SHEET 1 OF 1